


Notes

1. New section of 150mm dia outfall to follow the profile of the existing foreshore to MLWS
2. Pipe supports at approx 3m crs
3. Outfall point of discharge to NM 2263 5693
4. Outfall to be fitted with Tideflex valve and marker post

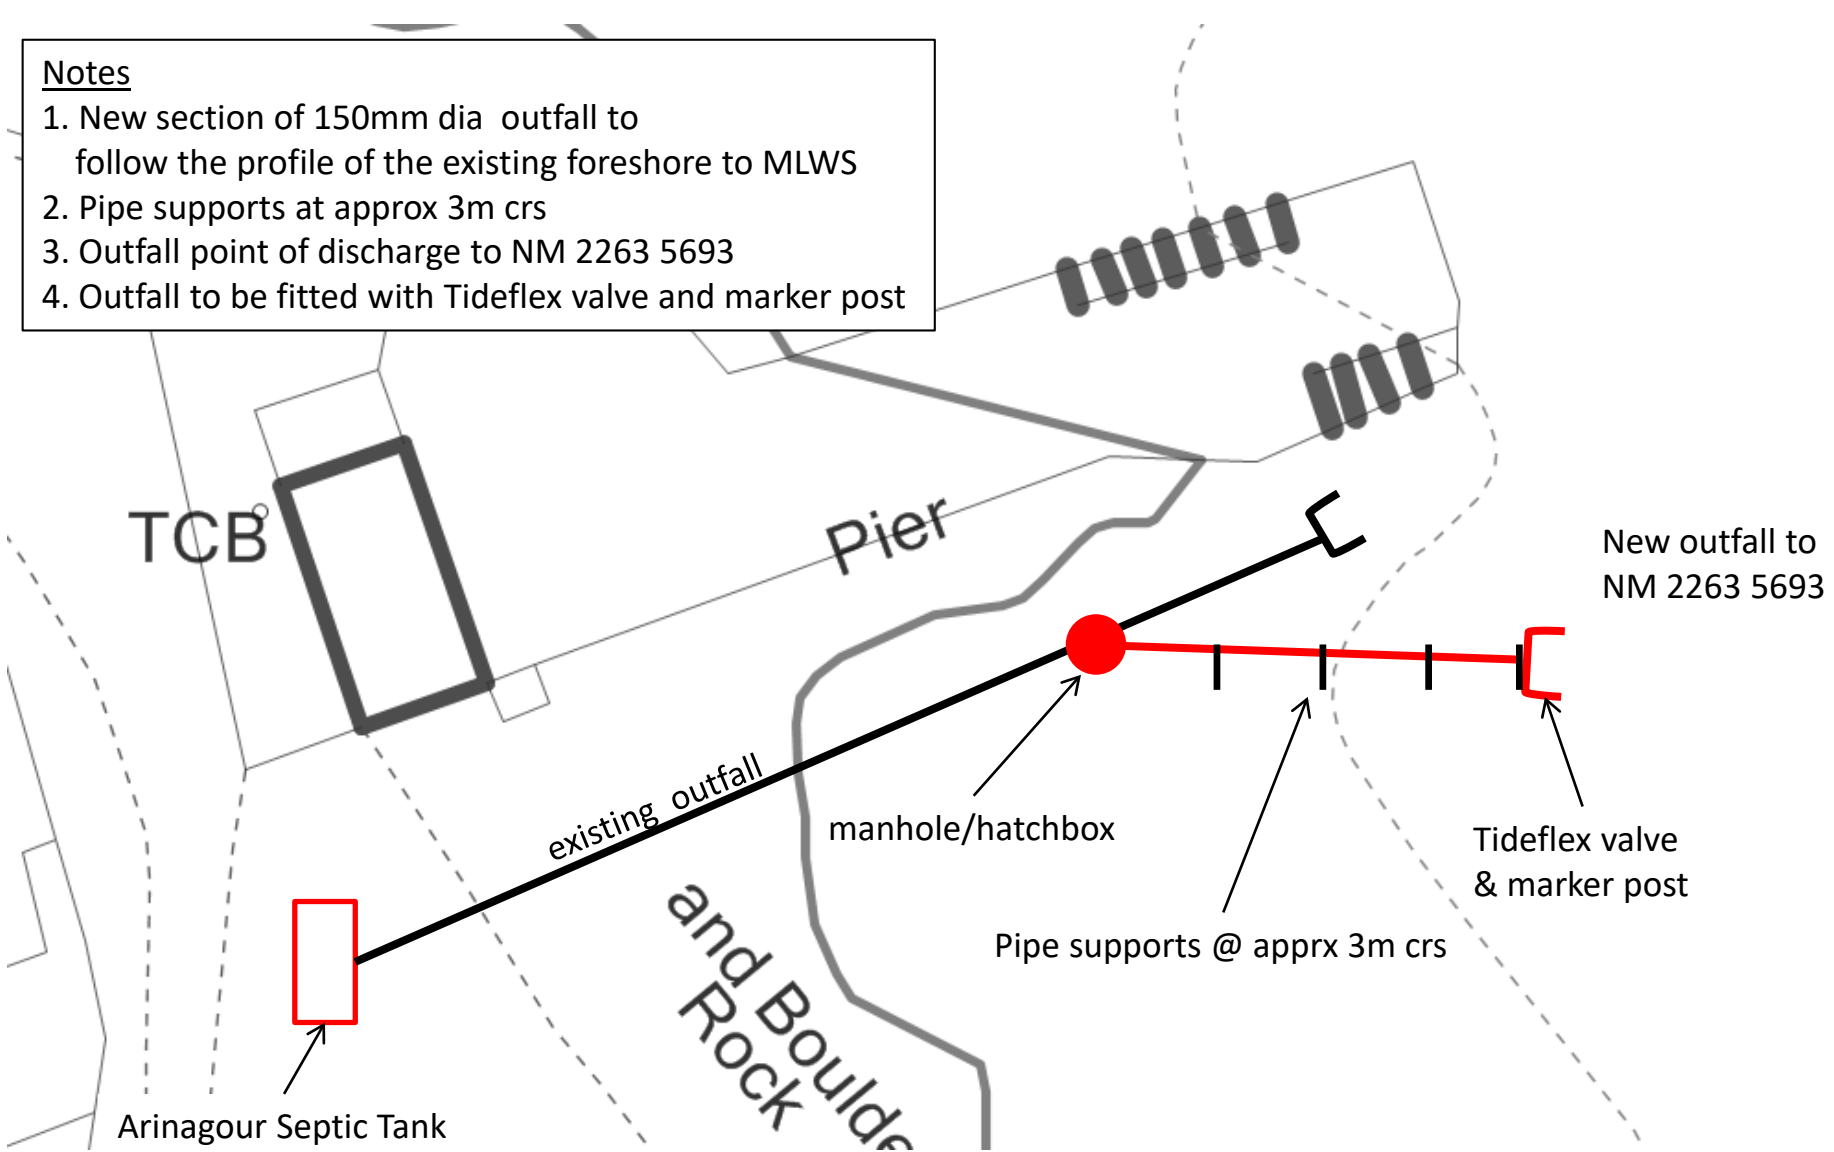

Extension to existing Septic Tank outfall (150mm dia)

Arinagour
Isle of Coll

Contractors area and access route to point of work



Extension to outfall

Septic tank

Extension to existing Septic Tank outfall

Arinagour

Isle of Coll