


- NOTES
- LEVELS ARE RELATIVE TO OS DATUM.
 - ALL DRAINAGE TO BE CONSTRUCTED IN ACCORDANCE WITH SEWERS FOR SCOTLAND.
 - ALL EXISTING DRAINAGE LINES AND LEVELS TO BE CONFIRMED ON SITE AND ANY DISCREPANCY REPORTED TO HGA.
 - ALL PIPEWORK 150mm Ø TO 450mm Ø TO BE STRUCTURED WALL UPVC TO WIS 4-35-01 UNLESS NOTED OTHERWISE.
 - BEDDING TO PIPEWORK TO BE IN ACCORDANCE WITH WIS 4-08-02.
 - TYPE 'A' AND TYPE 'B' MANHOLES TO BE PRE CAST CONCRETE WITH 675x675 DI COVERS TO BS EN 124 CLASS D400. ALL IN ACCORDANCE WITH SCOTTISH WATER STANDARDS DETAILS. FOR MANHOLES TYPES SEE LONG SECTION DRAWINGS.
 - ON COMPLETION OF WORKS CONTRACTOR TO PROVIDE AS BUILT SURVEY TO INCLUDE ALL MANHOLE LOCATIONS, COVER AND INVERT LEVELS AND PIPE SIZES.
 - ON COMPLETION OF WORKS CONTRACTOR TO PROVIDE CCTV SURVEY AND REPORT IN A FORMAT SUITABLE FOR SUBMISSION TO SCOTTISH WATER.
 - ALL WORKS TO BE INSPECTED AND APPROVED BY SCOTTISH WATER.

DRAINAGE LEGEND

— EXISTING FOUL SEWER

— PROPOSED SEWER

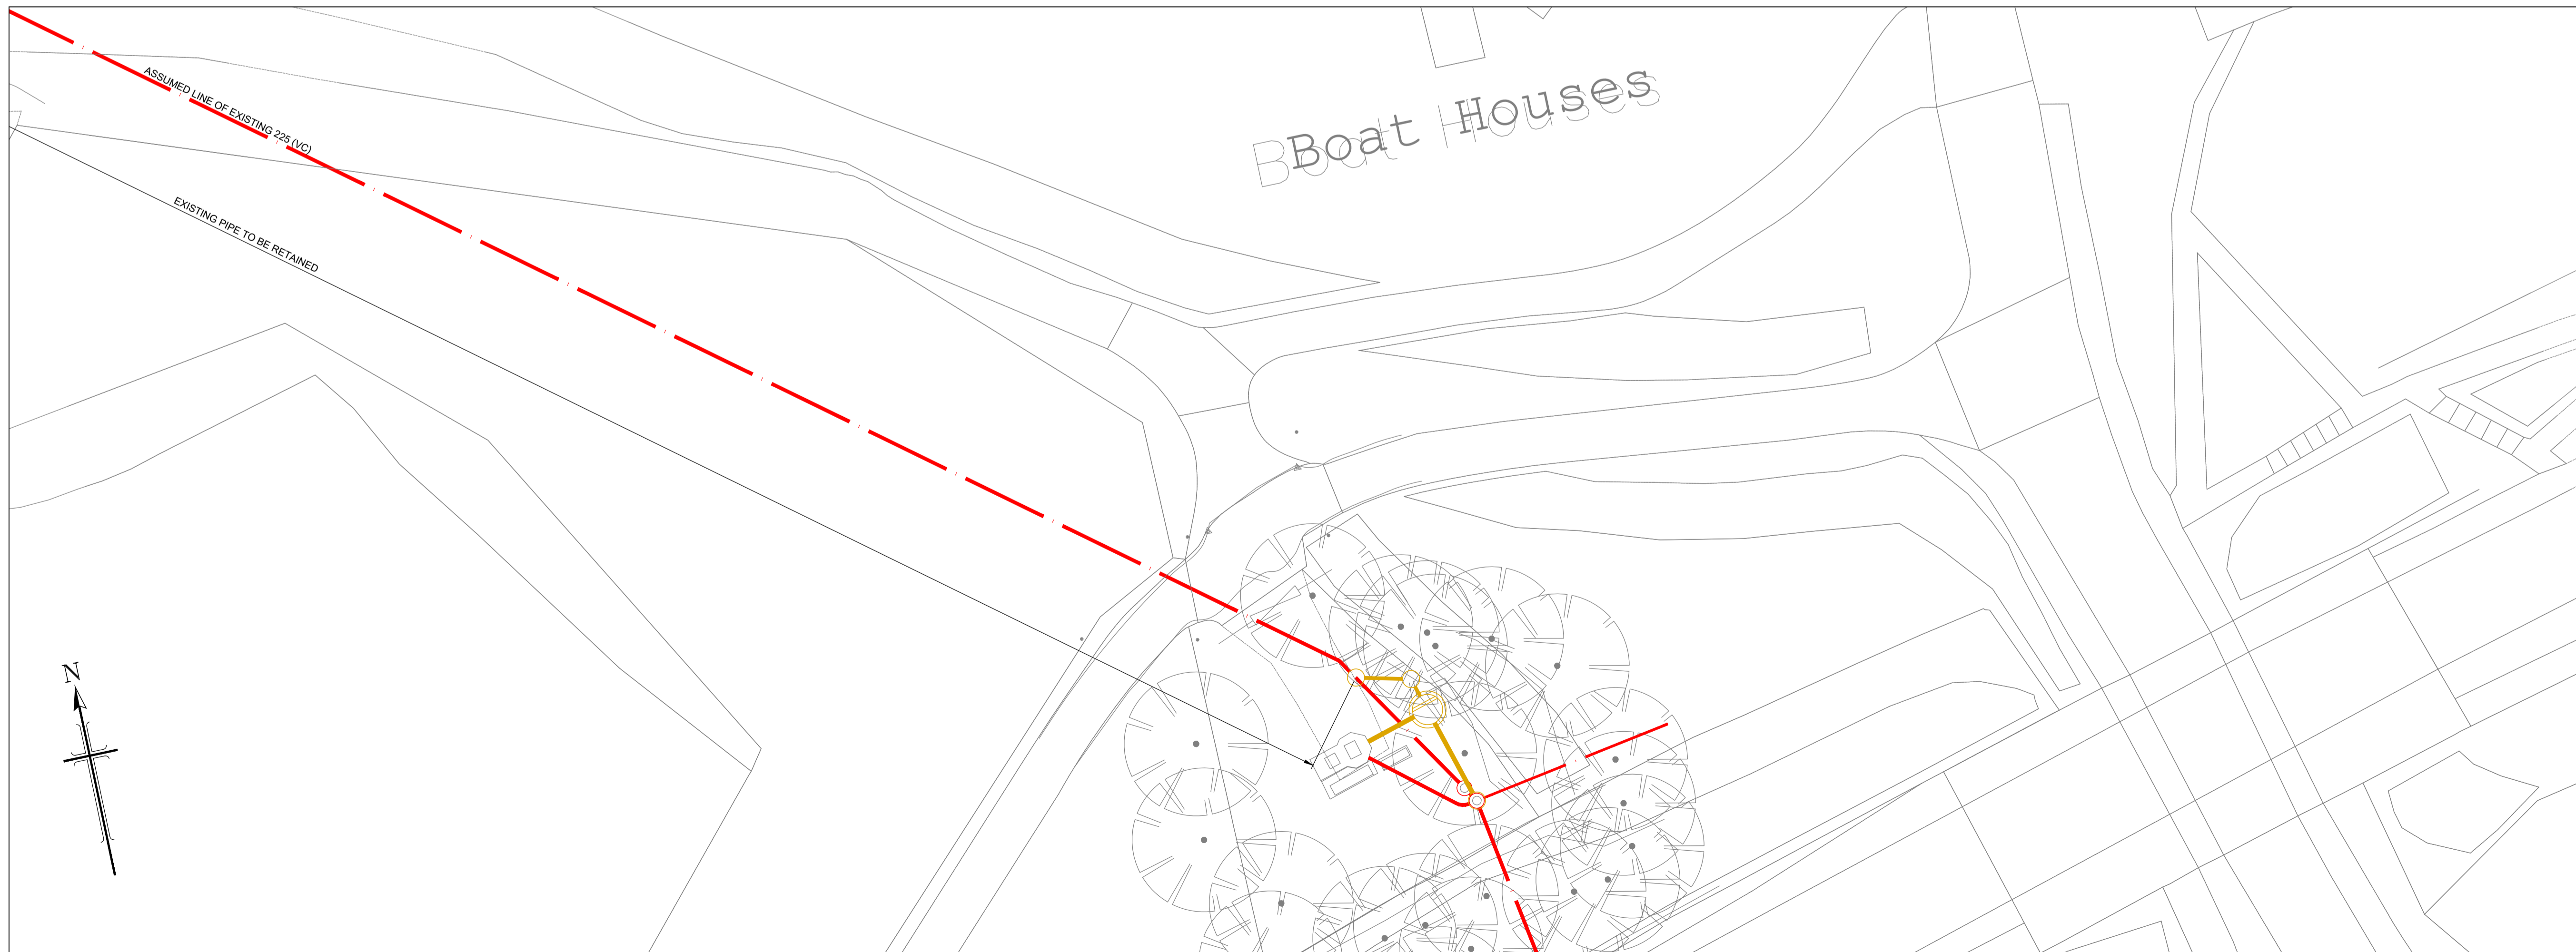

Drawing No.	Revision
3930:101/01	B

Revisions	Date	Drn.
A SHEET 3 ADDED. DETAILS REVISED.	26.10.23	IW
B OUTFALL MATERIAL REVISED.	11.01.24	IW

**CONSTRUCTION
DRAWING**

**SCOTTISH WATER
MAL CIVILS**

**EAST BALLACHULISH
OUTFALL**

**DRAINAGE IMPROVEMENTS
SHEET 1 OF 3**

Drawn: JM	Ck'd:	Scale: 1:250 (A1)
Date: SEPT 2023	Date:	DO NOT SCALE

consulting engineers
hga

HGA(UK) Ltd
Darach House
Stoneyfield Business Park
Inverness IV2 7PA
T: 01463 221717
F: 01463 224275
email: hga@hga-group.co.uk

Drawing No.	Revision
3930:101/01	B