

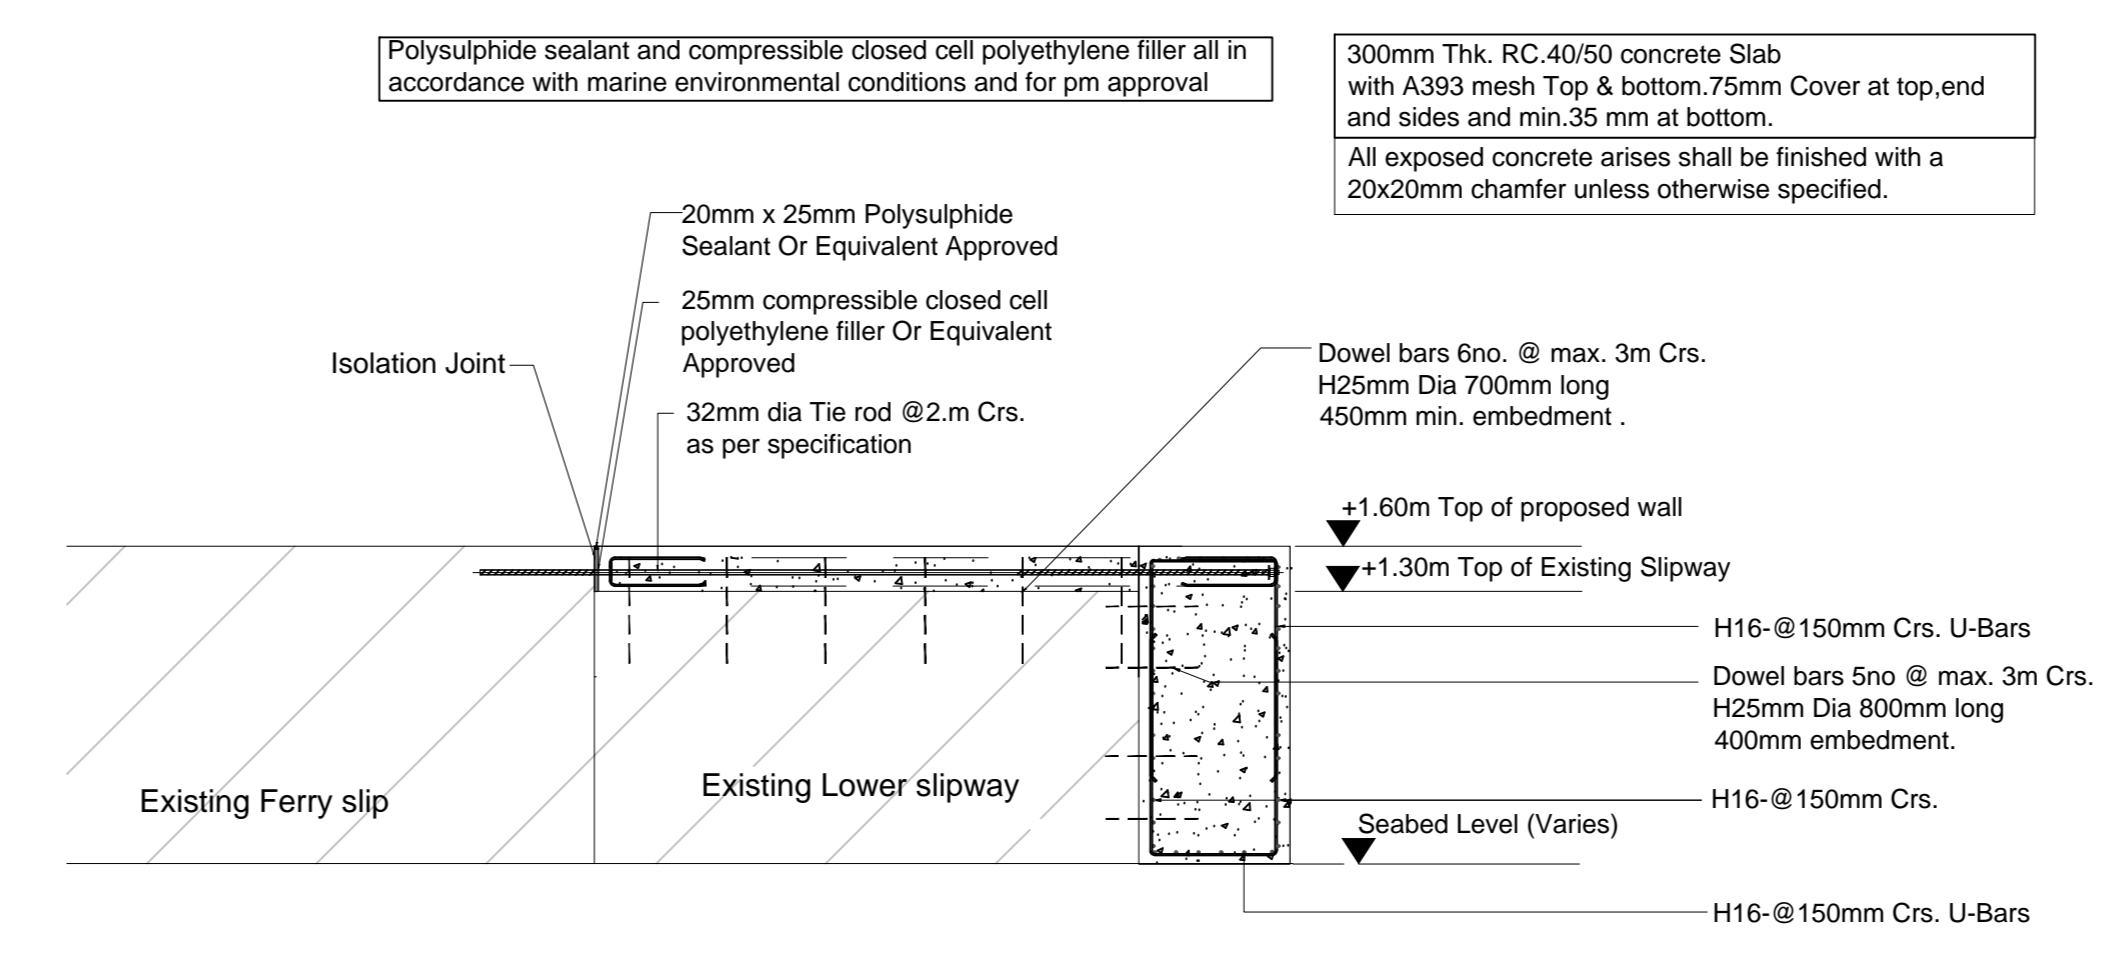
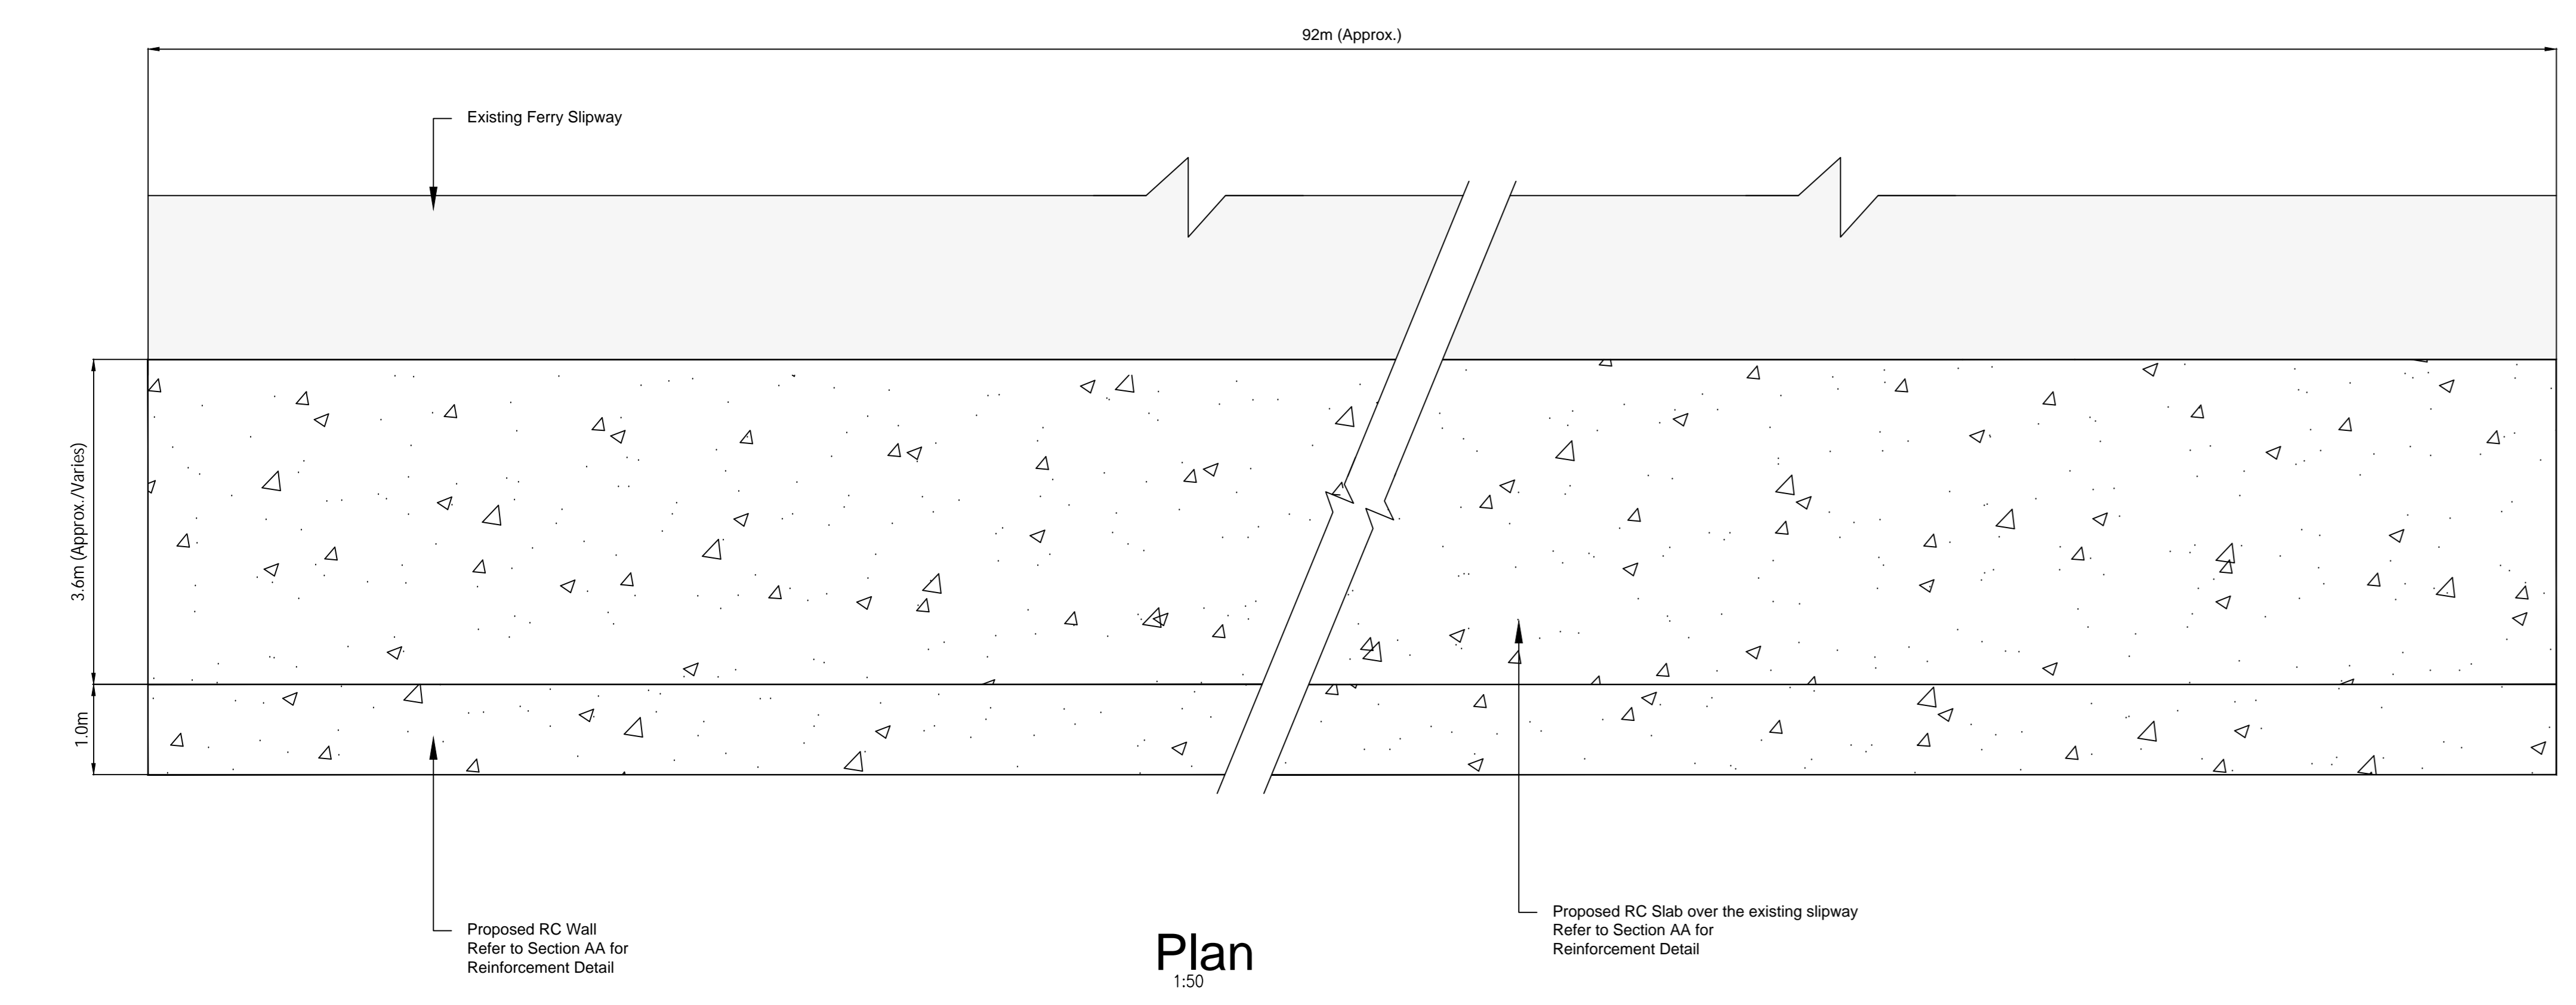
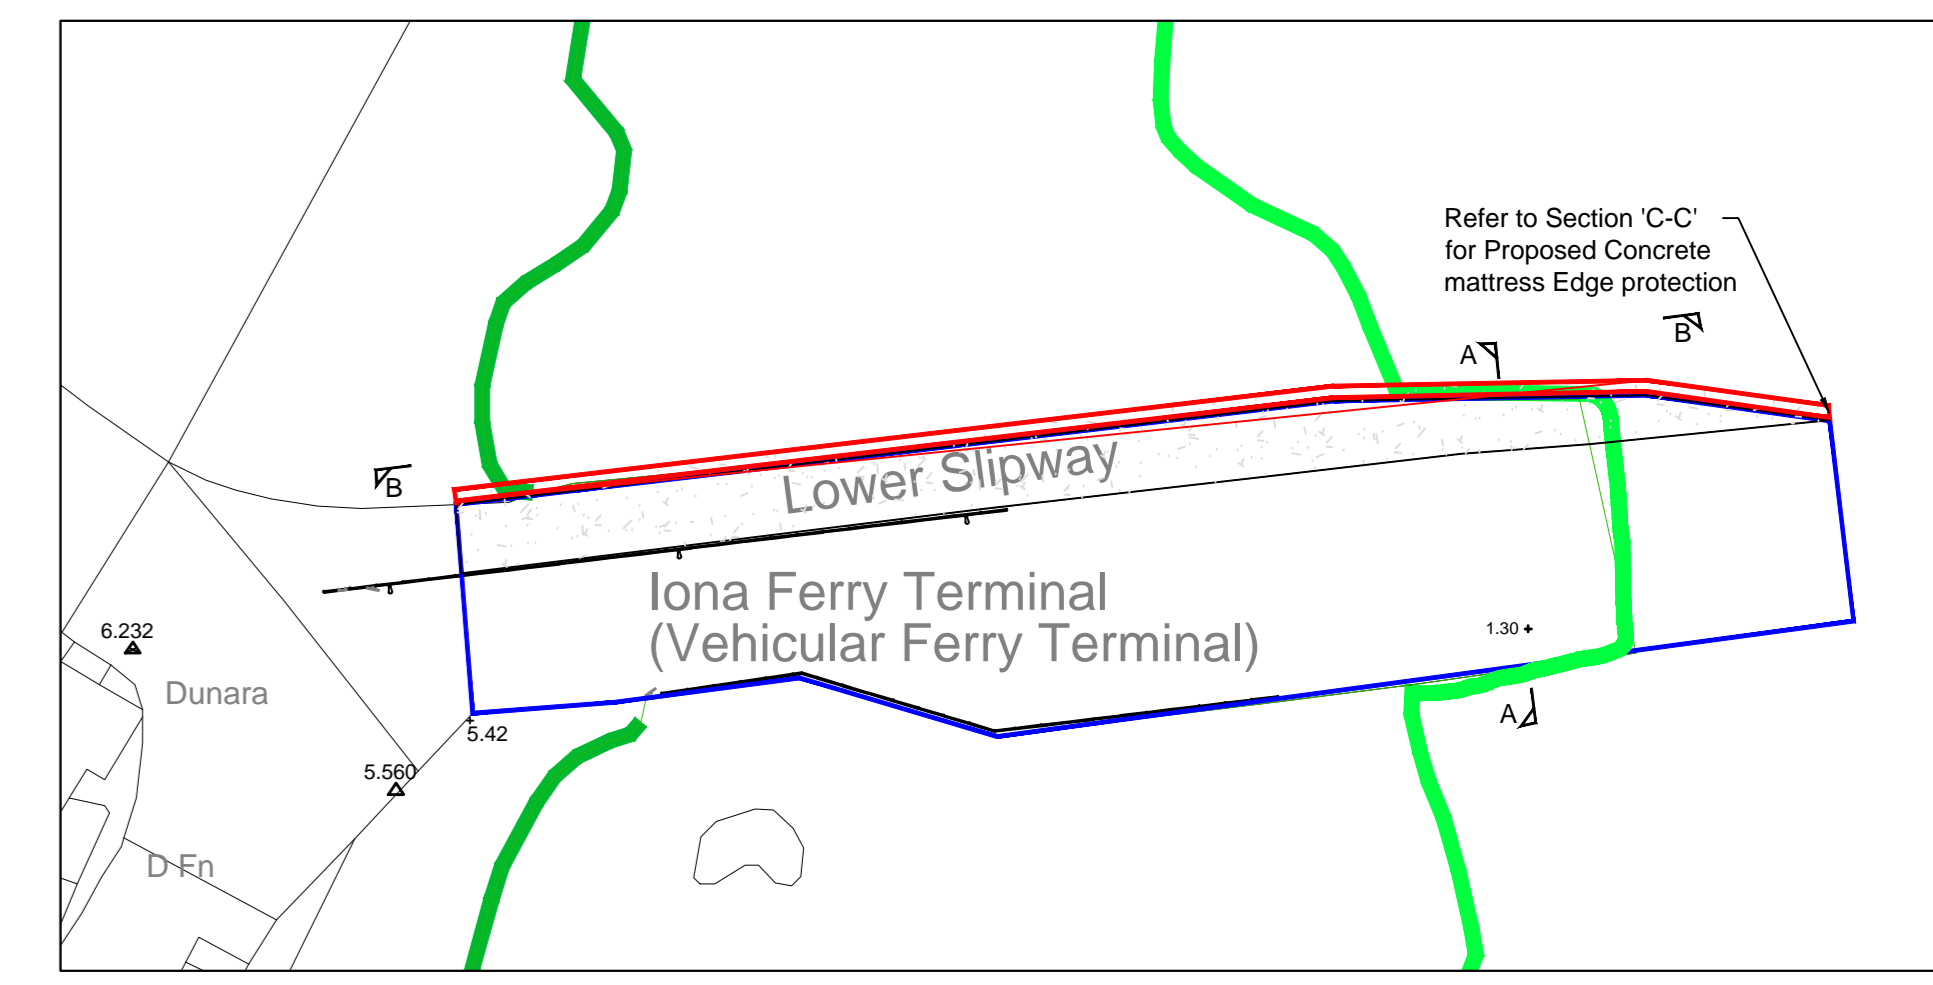
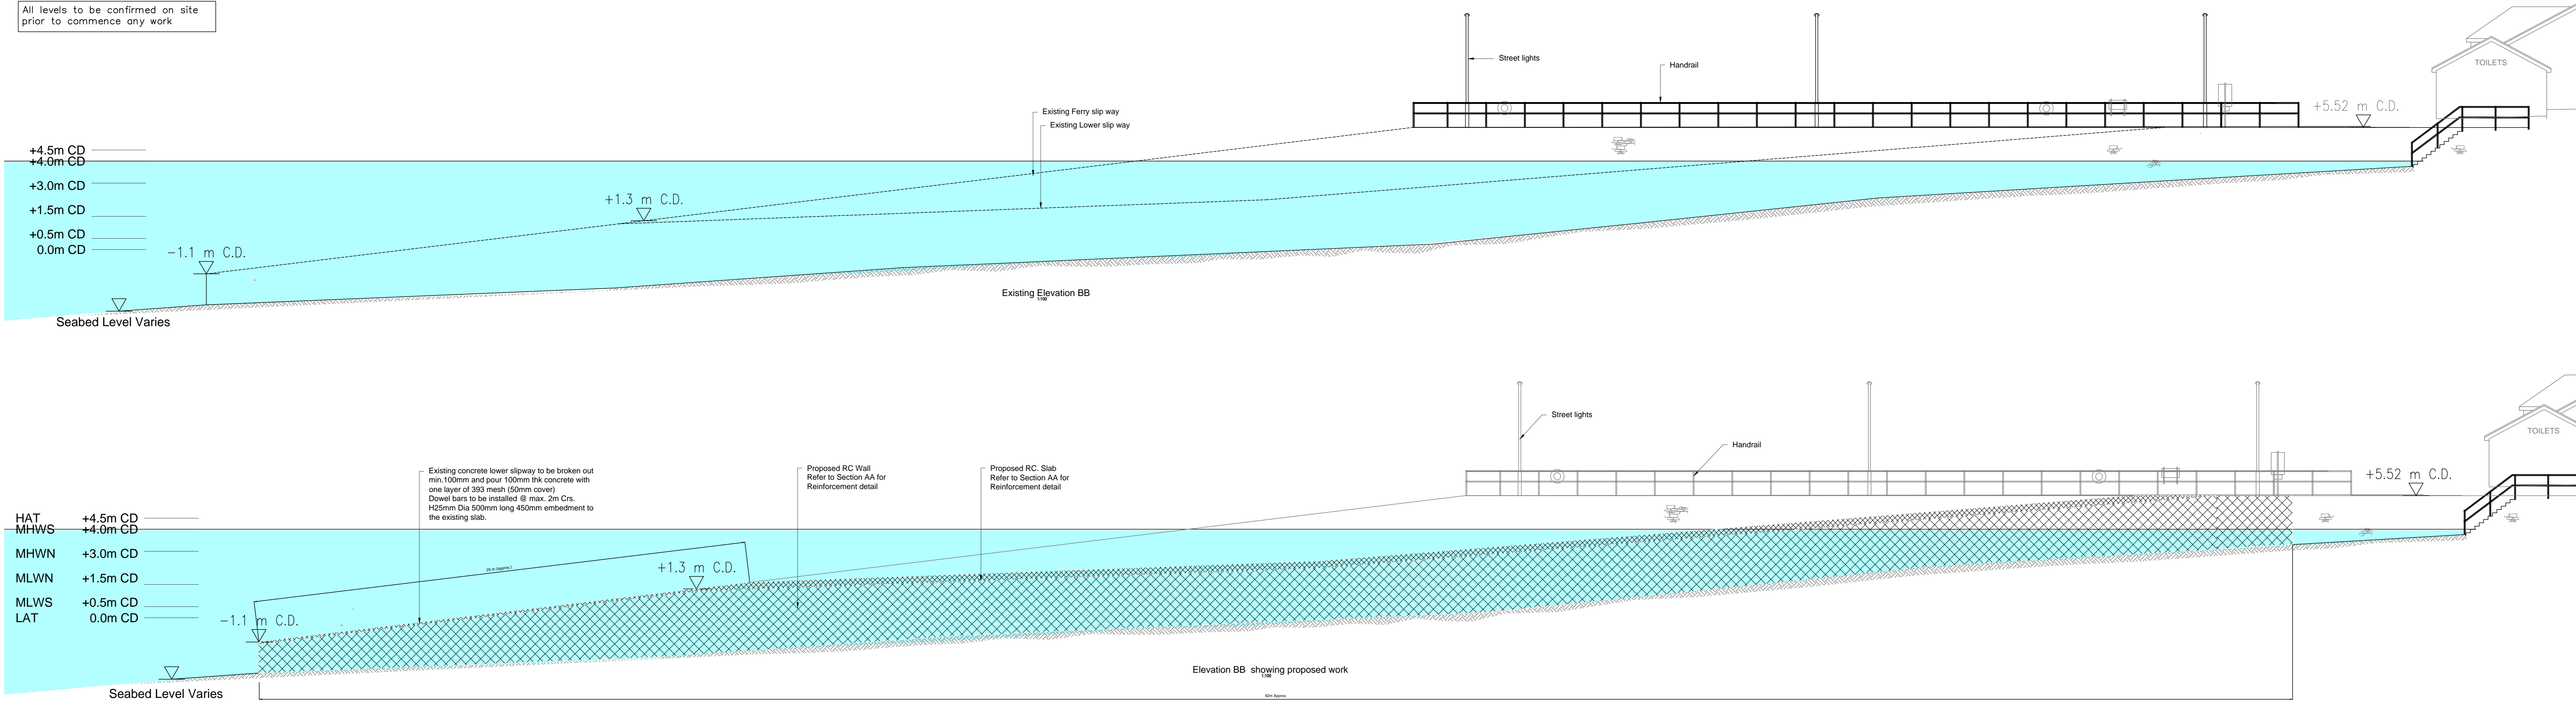
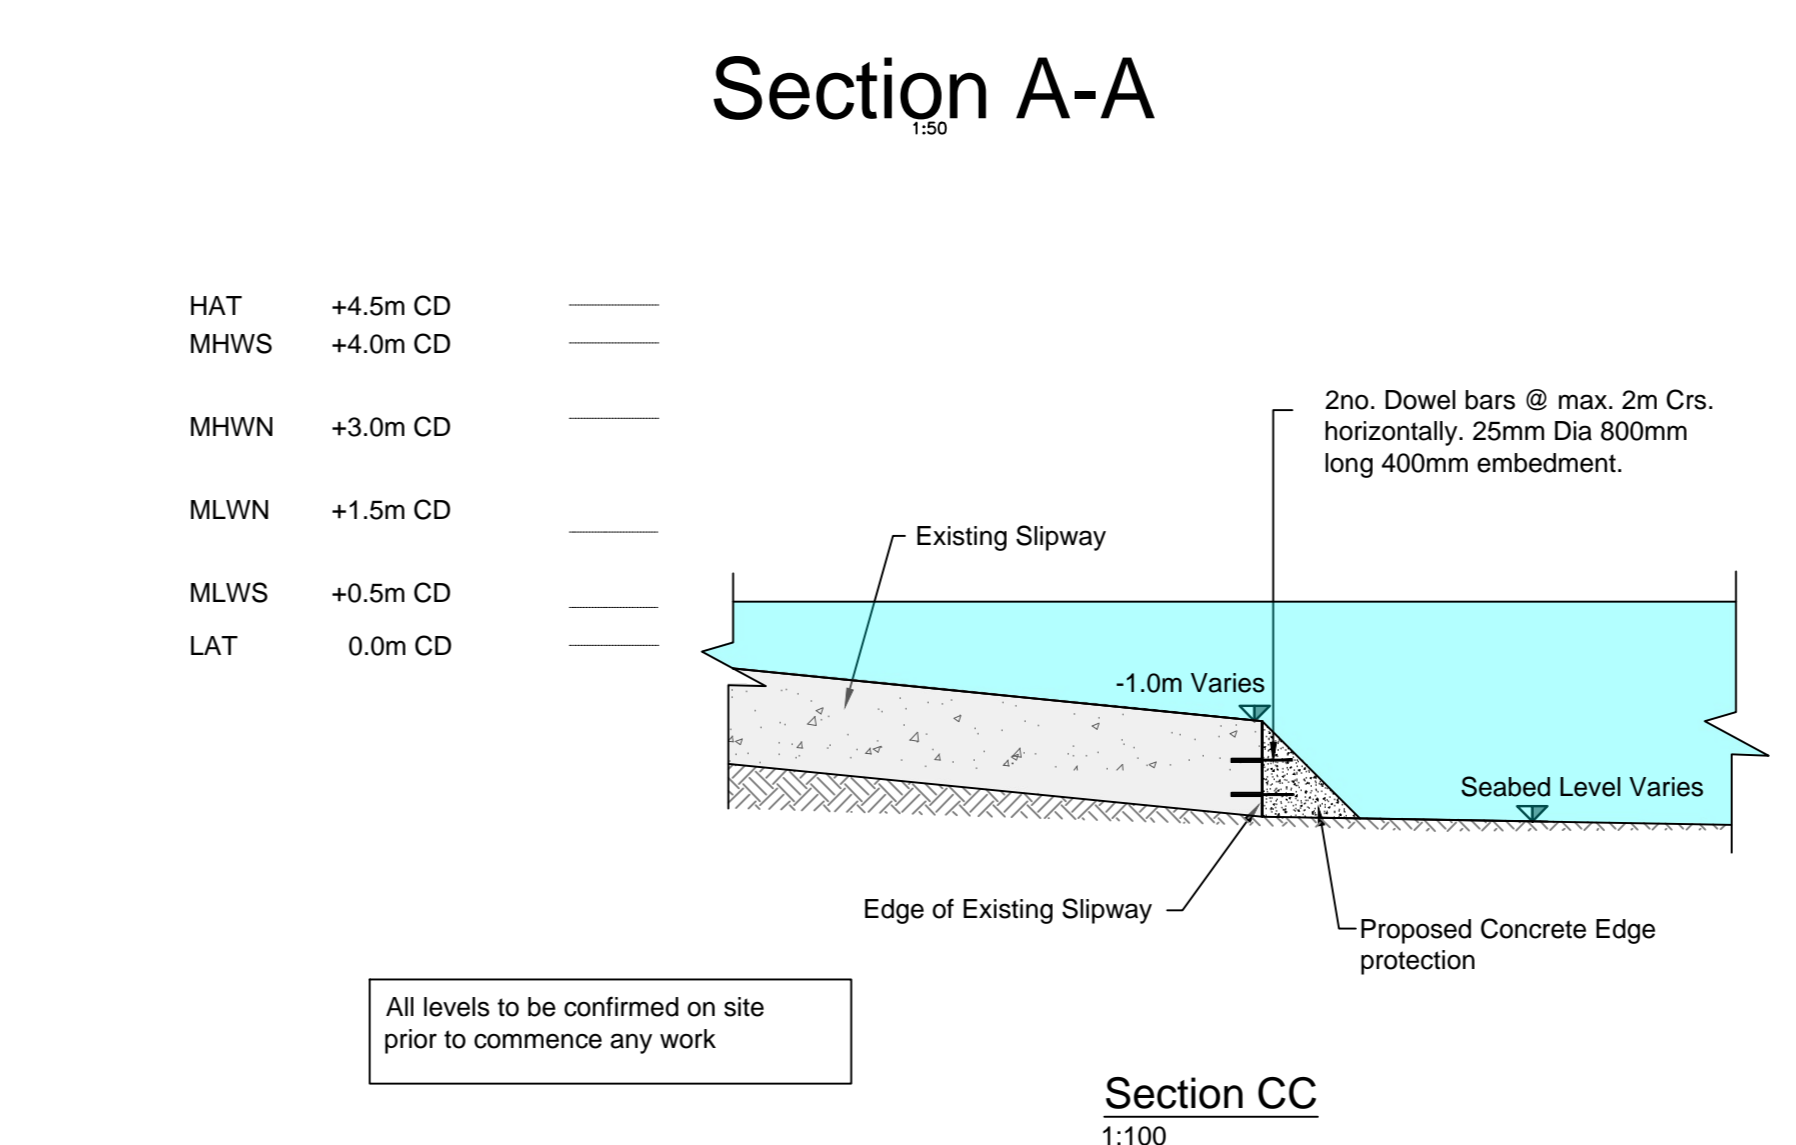


All levels to be confirmed on site prior to commence any work

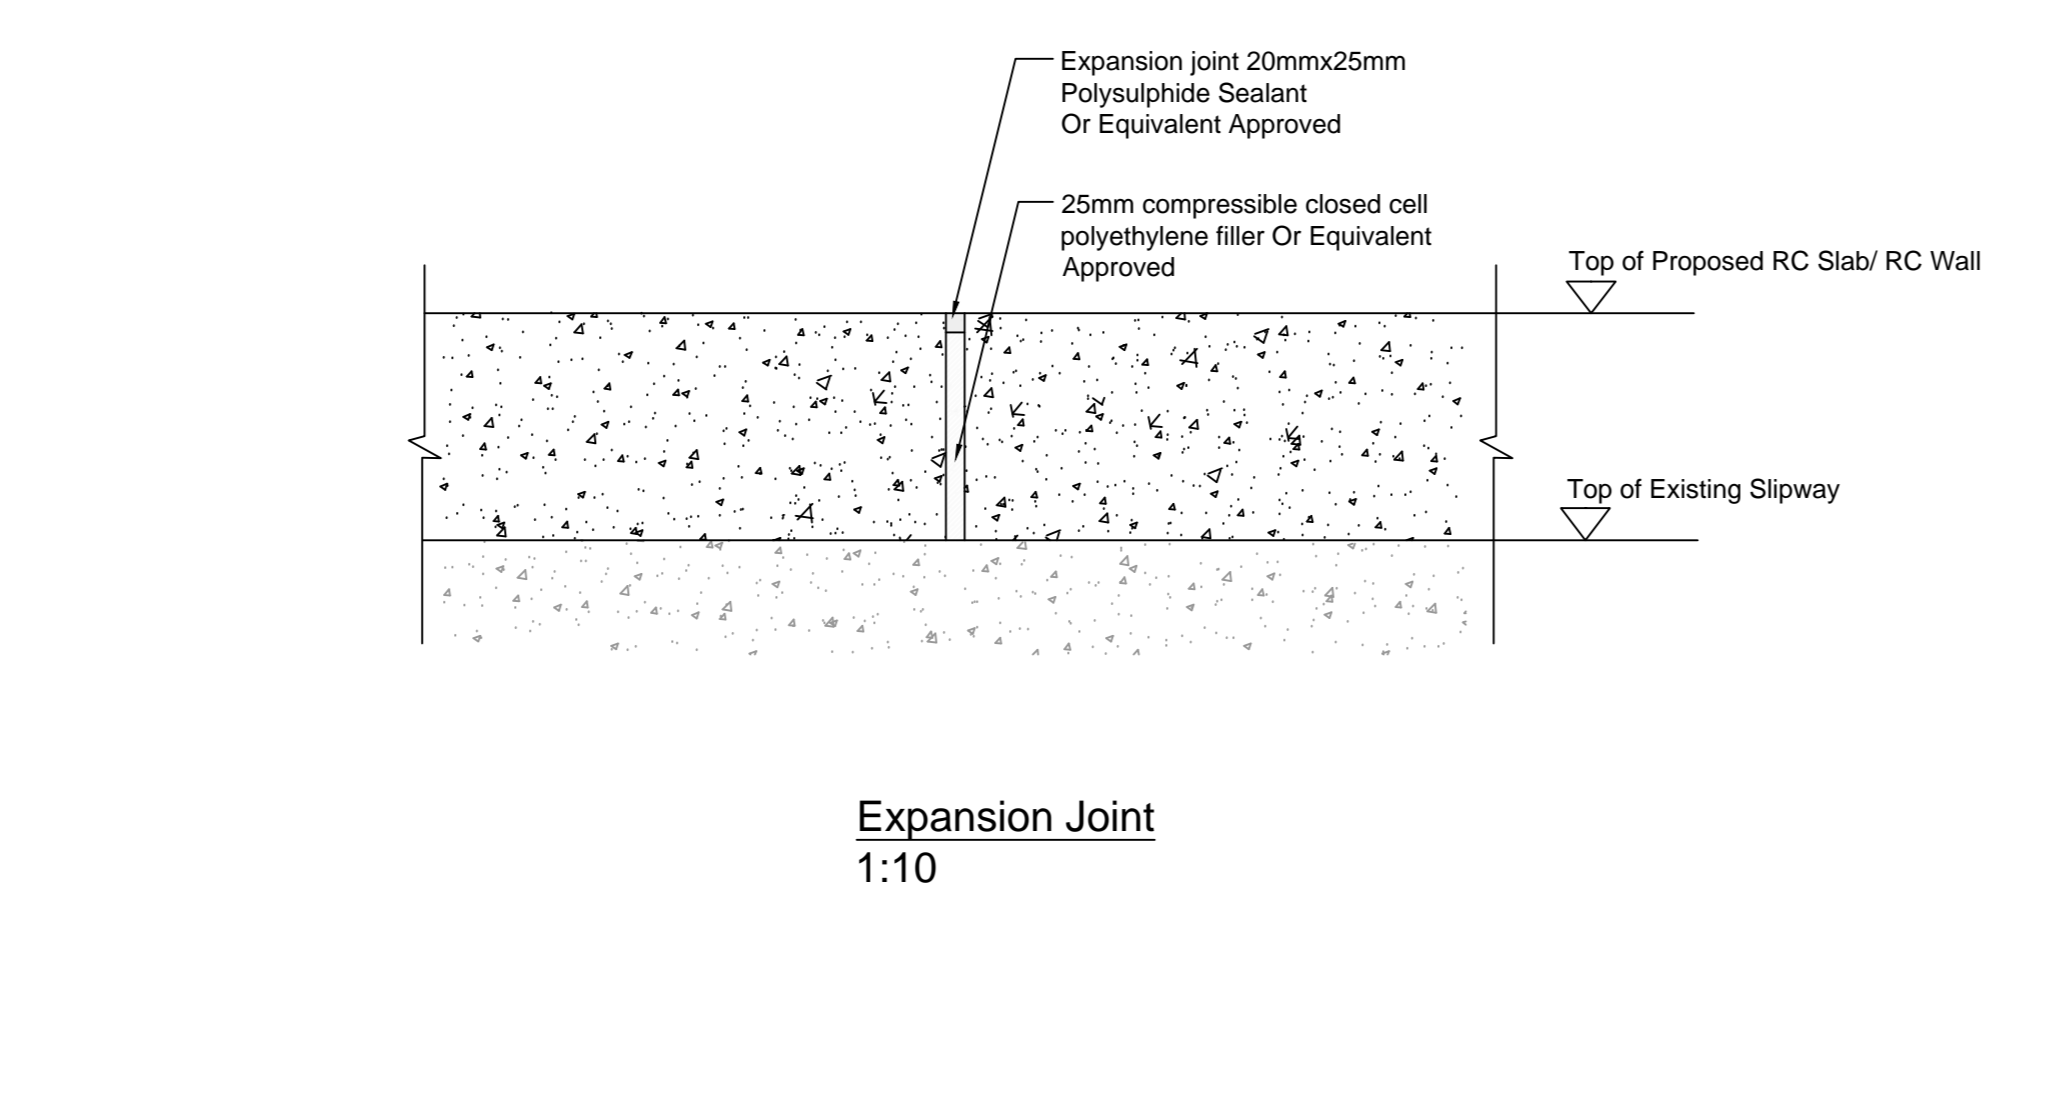

- HAT +4.5m CD
- MHWS +4.0m CD
- MHWN +3.0m CD
- MLWN +1.5m CD
- MLWS +0.5m CD
- LAT 0.0m CD

- General Notes:**
- All Levels are given in meters relative to local datum. Do not scale from this drawing.
 - This drawing is to be read in conjunction with the relevant specification and all other relevant drawings.
 - All concrete to be in accordance with BS 8110 and the spec. maximum nominal aggregate size to be 20mm. all fabric reinforcement to be high yield in accordance with BS 4443.
 - Concrete to be grade C40/50.
 - Minimum cover to reinforcement to be 75mm top, ends, sides & 35 mm bottom. u.n.o.
 - Minimum reinforcement laps to be :-
H10 = 400mm
H12 = 450mm
H16 = 600mm
H20 = 800mm
H25 = 1000mm
H32 = 1200mm
 - All reinforcement to be bent and fixed in accordance with BS 8666:2005
 - Where bars lapping are of different diameter use lap for the smaller bar.

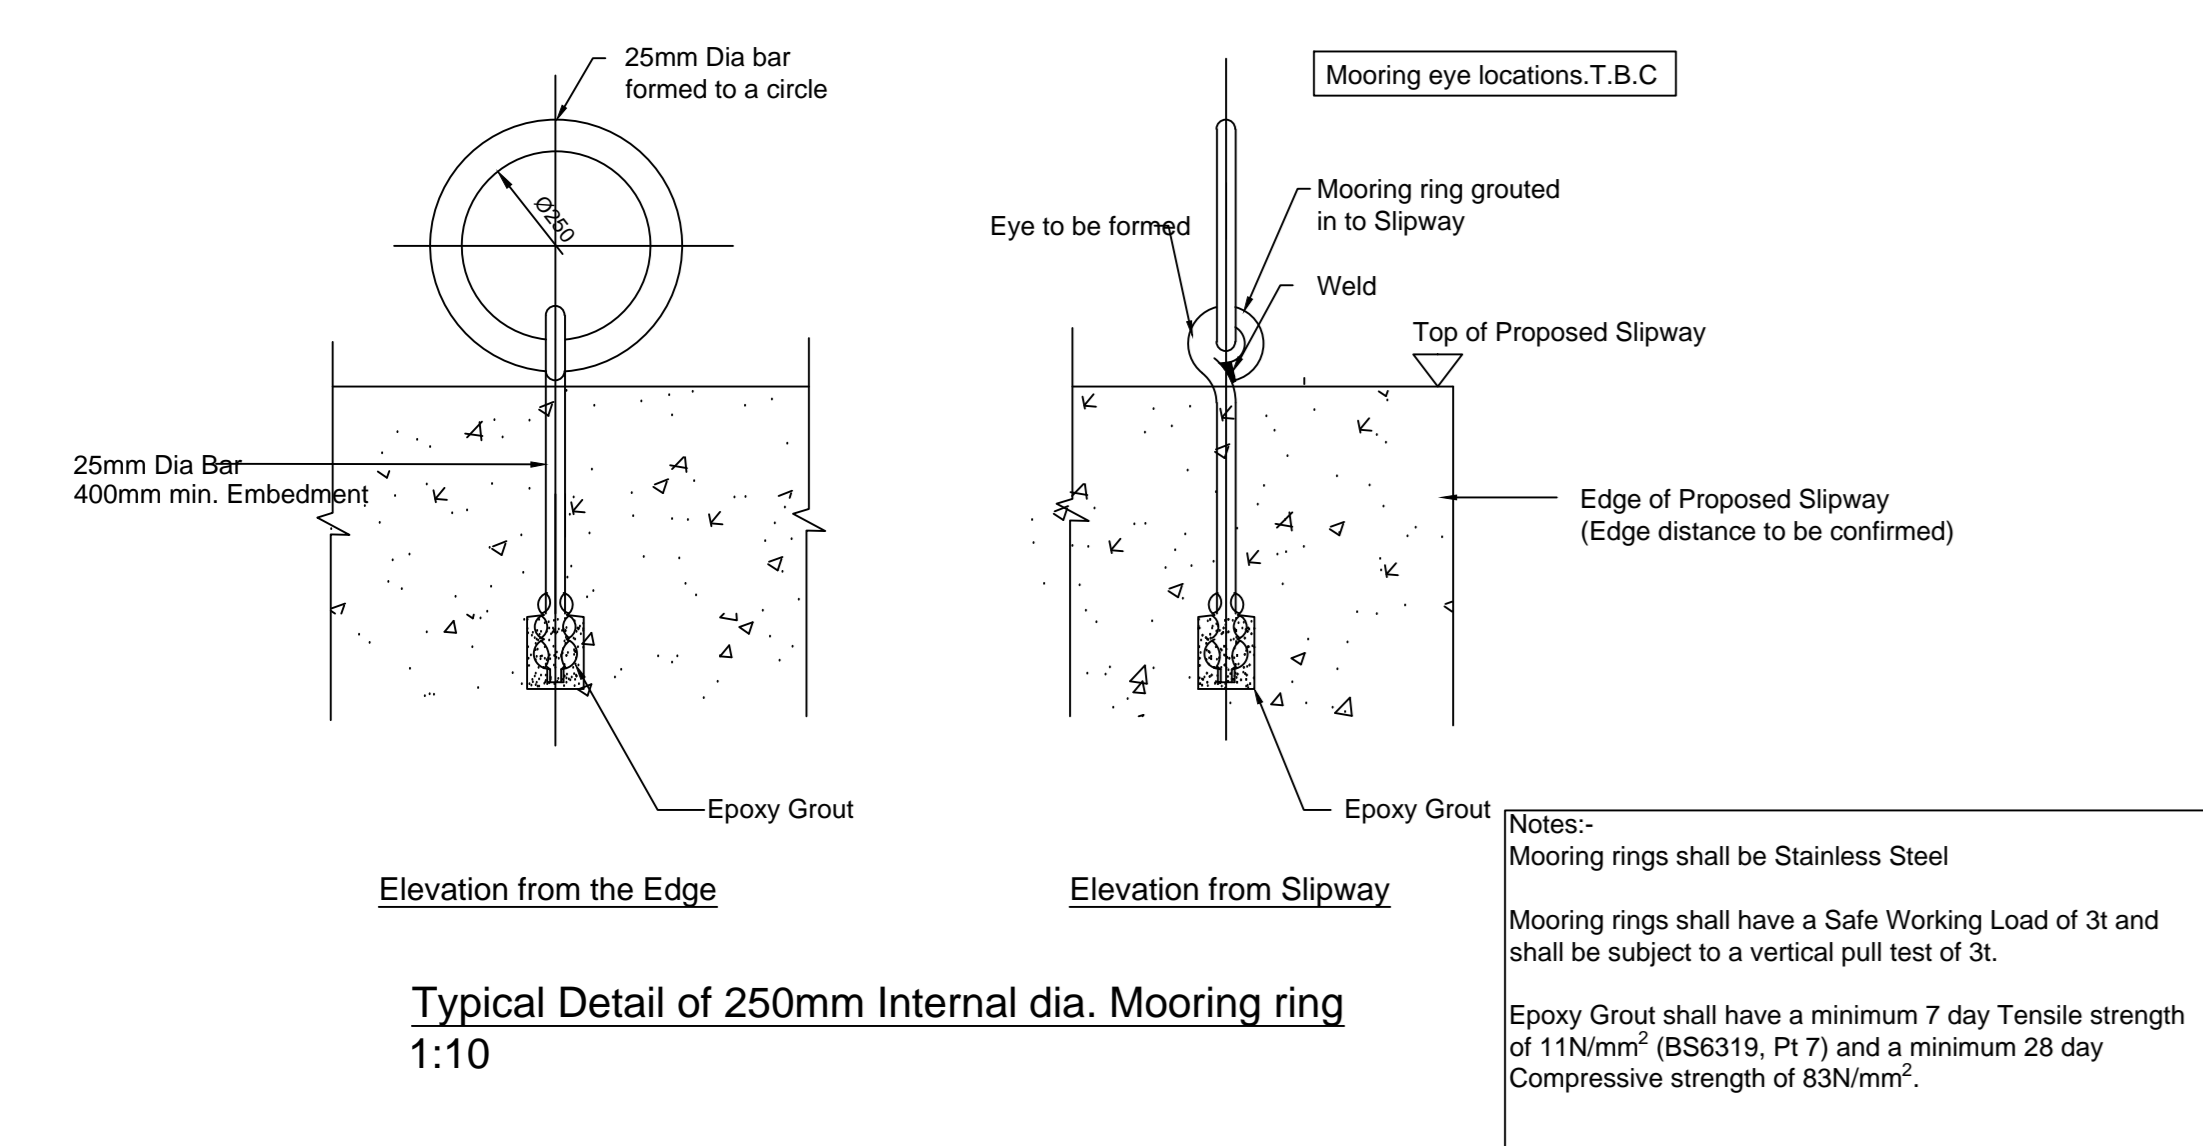

Head of Roads and Infrastructure Services
Jim Smith

DESIGN OFFICE,
MANSE BRAE, LOCHGILPHEAD, ARGYLL, PA31 8RD

TITLE
Iona Slipway Remedial works
Existing Elevation, Proposed Elevation,
Proposed Sections and Details

DESIGNED BY		ES	DRAWING No.		00040-34-002
DRAWN BY		ST	As Shown @ A0		
CHECKED BY		ES	Argyll & Bute COUNCIL		
APPROVED BY		ES			
SUFFIX	REVISION	INIT.	DATE	INIT.	DATE
		DESIGNED BY	08/10/2020	APPROVED BY	