



PLAN OF APPROX 30m TRANSFER REPLACEMENT PIPE THROUGH PROPOSED ROCK REVETMENT

SCALE 1:50

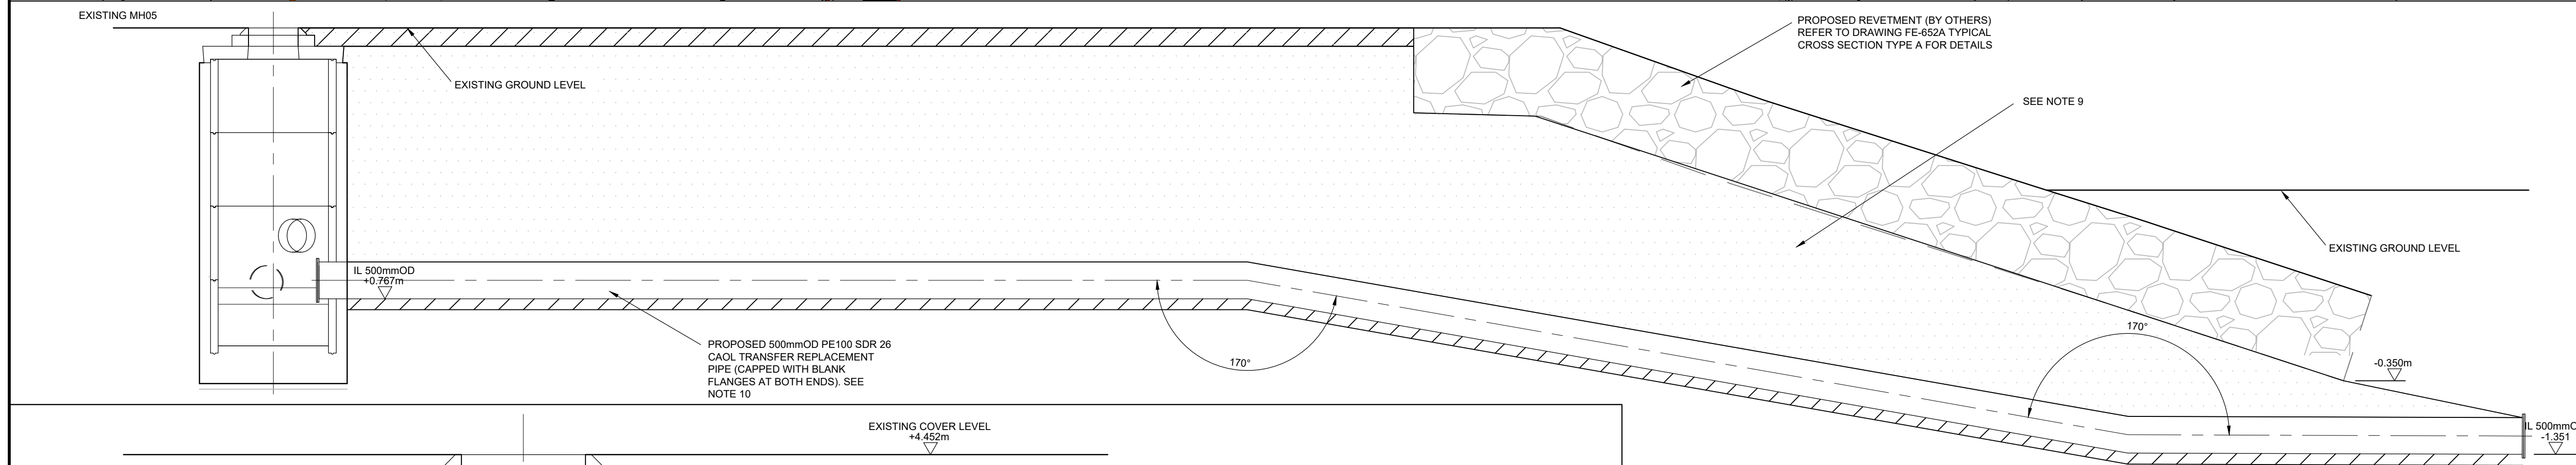

SECTION OF APPROX 30m TRANSFER REPLACEMENT PIPE THROUGH PROPOSED ROCK REVETMENT

SCALE 1:50

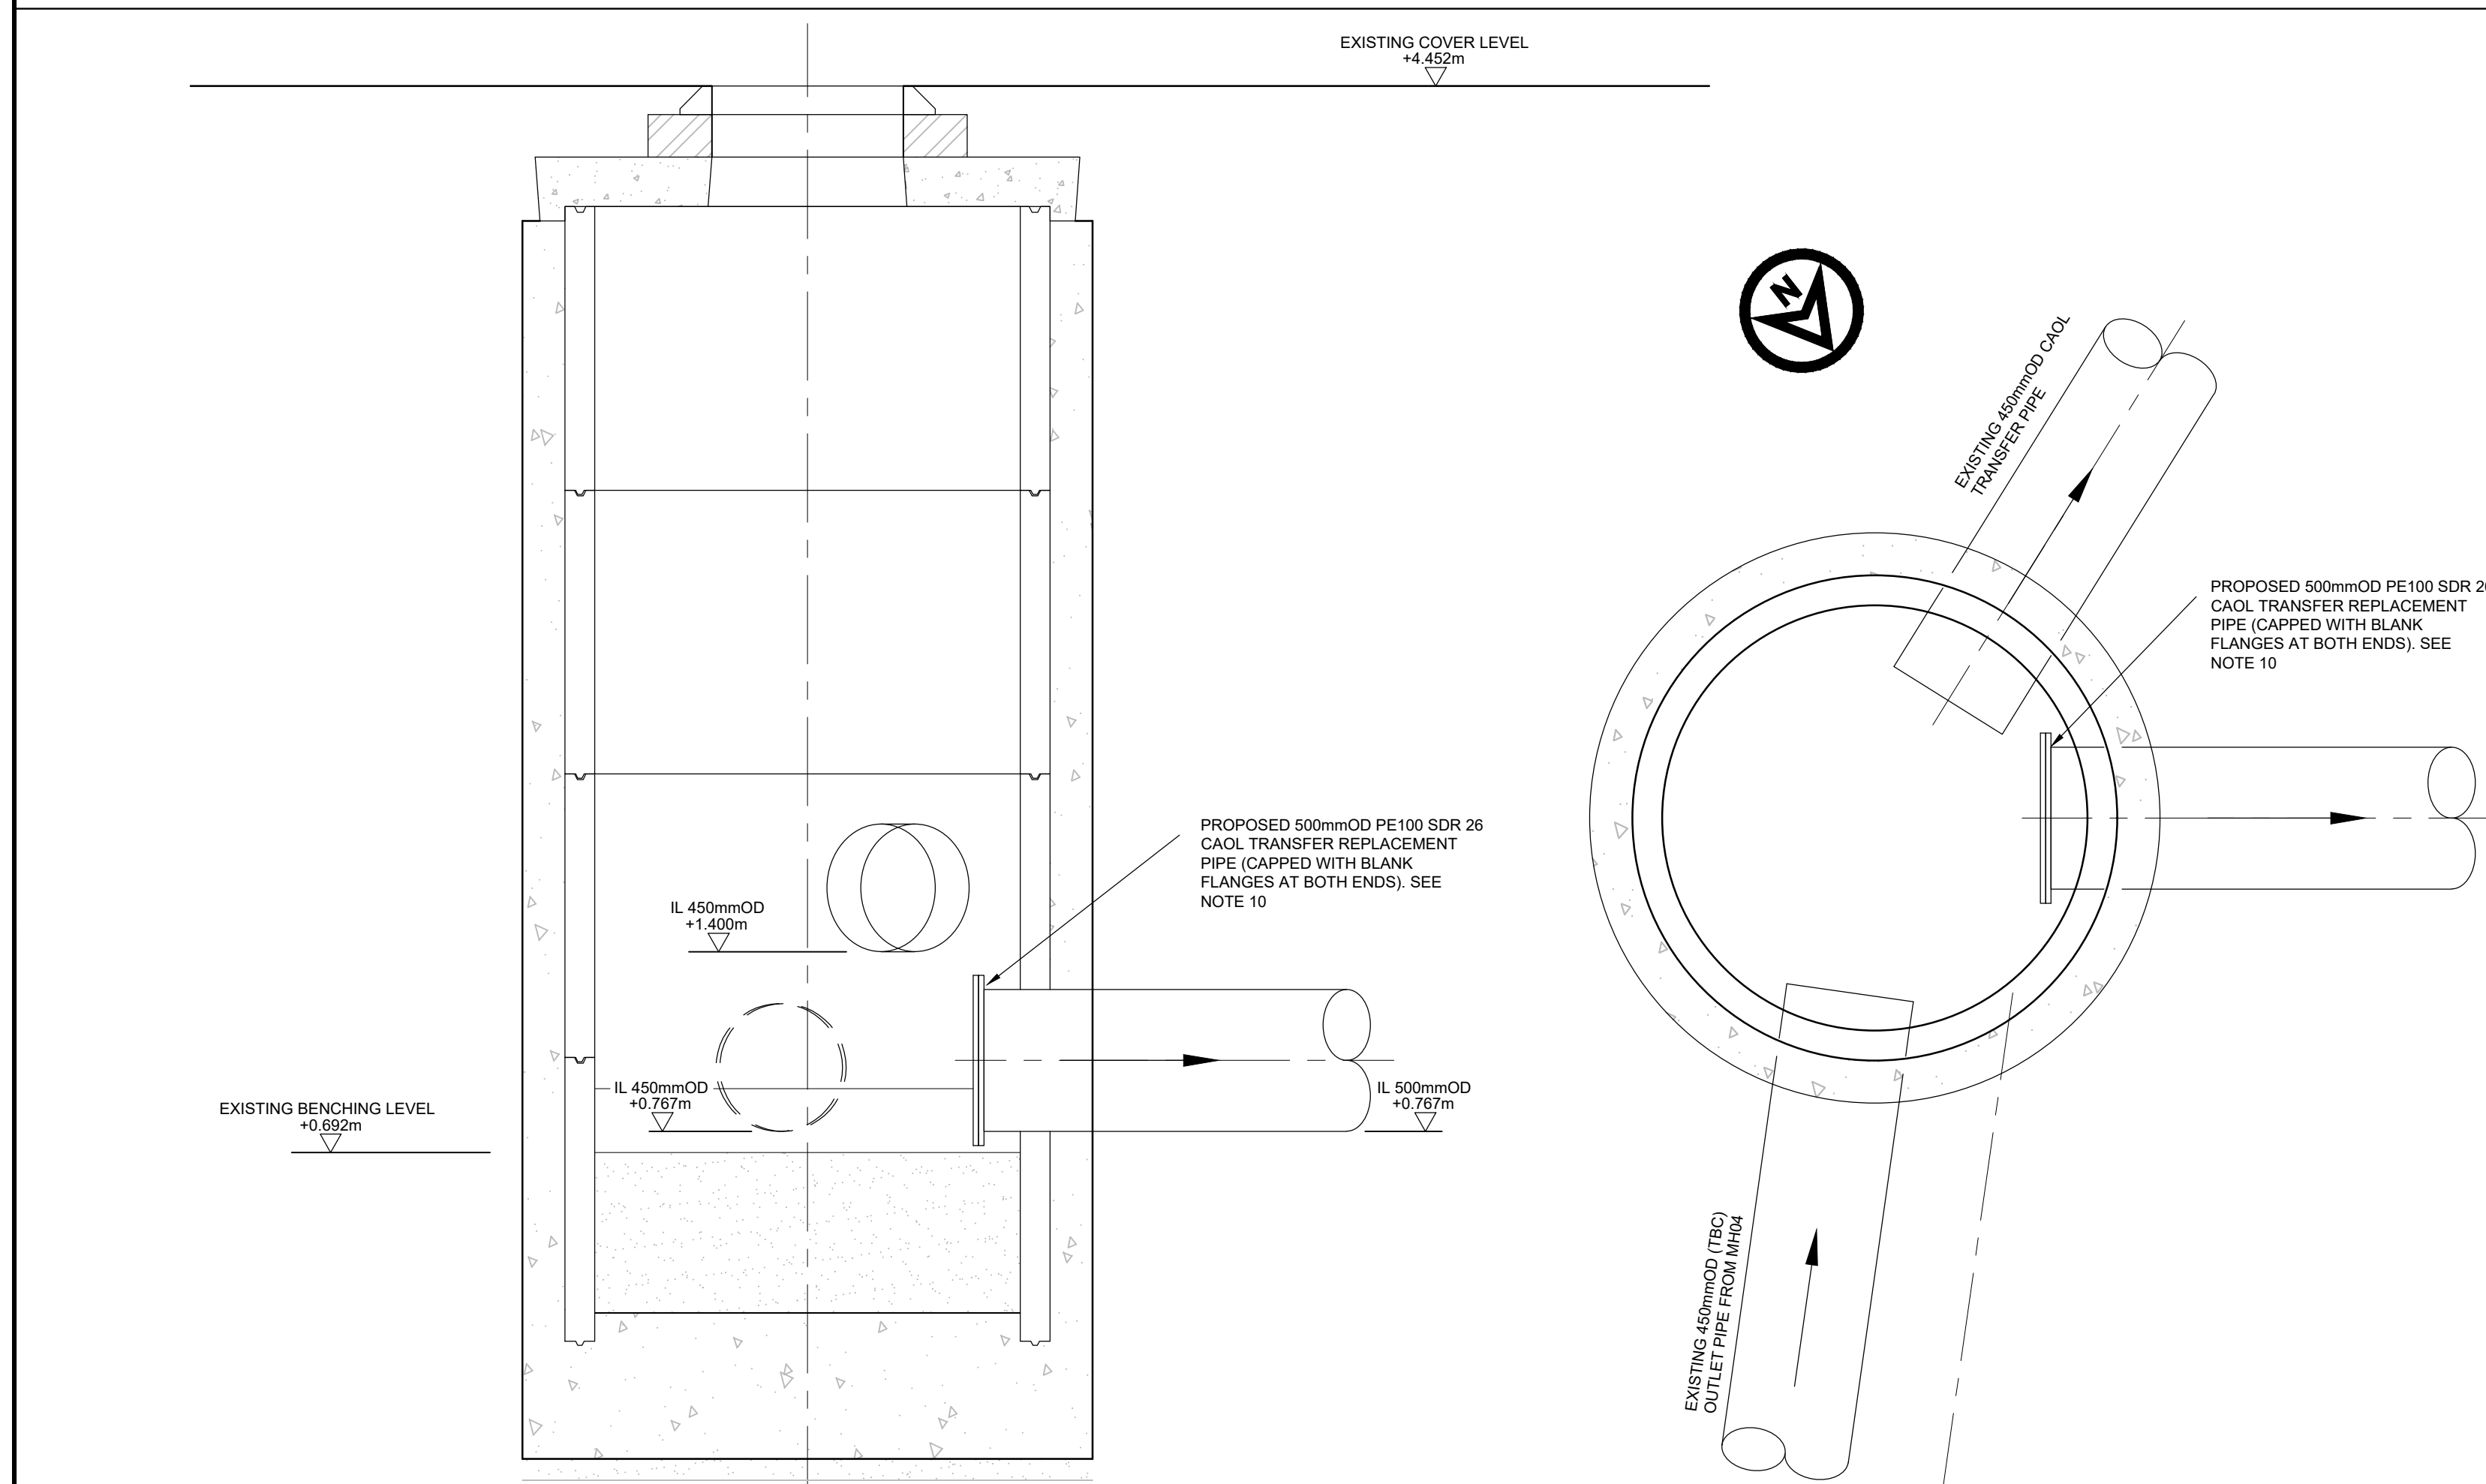

SECTION THROUGH EXISTING MH05

SCALE 1:20

PLAN ON EXISTING MH05

SCALE 1:20

NOTES

1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
2. ALL LEVELS ARE IN METRES RELATIVE TO ORDNANCE DATUM (mOD) UNLESS NOTED OTHERWISE.
3. TYPICAL MANHOLE DETAILS AS PER SEWERS FOR SCOTLAND V4.0 GUIDANCE DOCUMENTS
4. MANHOLE (MH05) LEVEL DETAILS OBTAINED FROM SURVEYS CONDUCTED BY COMMENDIUM LTD
5. INLET AND OUTLET PIPE NOT SURVEYED DUE TO BEING BELOW THE WATERLINE AT THE TIME OF THE SURVEY (BY COMMENDIUM LTD). PIPE LEVELS HAVE BEEN ASSUMED BASED ON INFORMATION FROM FORT WILLIAM DOA NETWORK MODEL REVIEW MEMO BY JACOBS LTD UK
6. LEVEL OF INLET AND OUTLET PIPES TO BE CONFIRMED PRIOR TO CONSTRUCTION
7. BLANK FLANGES TO BE REMOVED PRIOR TO COMMISSIONING OF CAOL TRANSFER REPLACEMENT OUTFALL
8. LEVEL OF EXISTING SERVICE CROSSINGS TO BE CONFIRMED PRIOR TO CONSTRUCTION
9. BEDDING DETAILS AND MATERIALS AND BACKFILLING SHALL BE IN ACCORDANCE WITH PART 4 OF THE SEWERS FOR SCOTLAND V4.0 GUIDANCE UNLESS OTHERWISE AGREED. CLASS S BEDDING FOR FLEXIBLE PIPES SHALL BE ADOPTED AS SHOWN ON DRAWING NO. PC1651-RHD-ZZ-ZZ-DR-C-0004
10. CONNECTION TO EXISTING TO MH05 TO BE DETERMINED BY CONTRACTOR AND APPROVED BY EMPLOYER

**NOT FOR CONSTRUCTION**

REV	DATE	DESCRIPTION	BY	CHK	APP
PO1	18.02.21	FOR INFORMATION	SM	DA	WH

REVISIONS

CLIENT



PROJECT  
CAOL NO.1 & CAOL TRANSFER OUTFALLS

TITLE  
CAOL TRANSFER REPLACEMENT OUTFALL CONNECTION DETAILS AT CAOL TRANSFER (EXISTING MH05)



DRAWN	CHECKED	APPROVED
SM	DA	WH

DATE	SCALE	REF.
01.02.21	1:20	

DRAWING No.	SUITABILITY	REVISION
PC1651-RHD-ZZ-ZZ-DR-C-0008	S3	P01