



SECTION 1 - 1 THROUGH CENTRE LINE OF RAMP
1 : 100


- NOTES:**
1. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS NOTED OTHERWISE.
 2. ALL MATERIALS & WORKMANSHIP WILL BE AS DEFINED IN THE SPECIFICATION UNLESS NOTED OTHERWISE.
 3. CONCRETE IS TO BE GRADE C40/50 TO BE EN 1992-1-1 UNLESS NOTED OTHERWISE.
 4. NOMINAL COVER TO REINFORCEMENT IS TO BE 75mm UNLESS NOTED OTHERWISE.
 5. REINFORCEMENT SHALL BE GRADE B500B OR C TO EN 10080 UNLESS NOTED OTHERWISE.

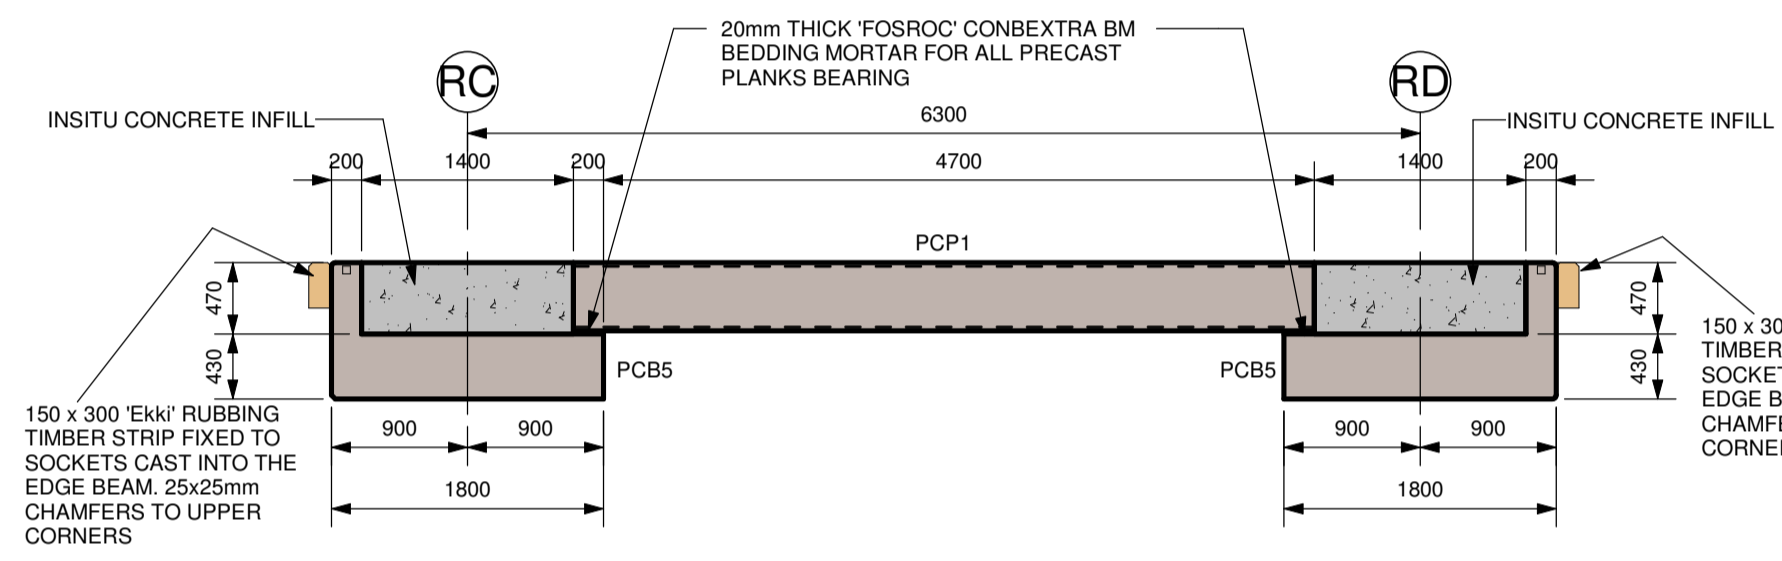


SECTION A - A TYPICAL BETWEEN PILE BENTS
1 : 50

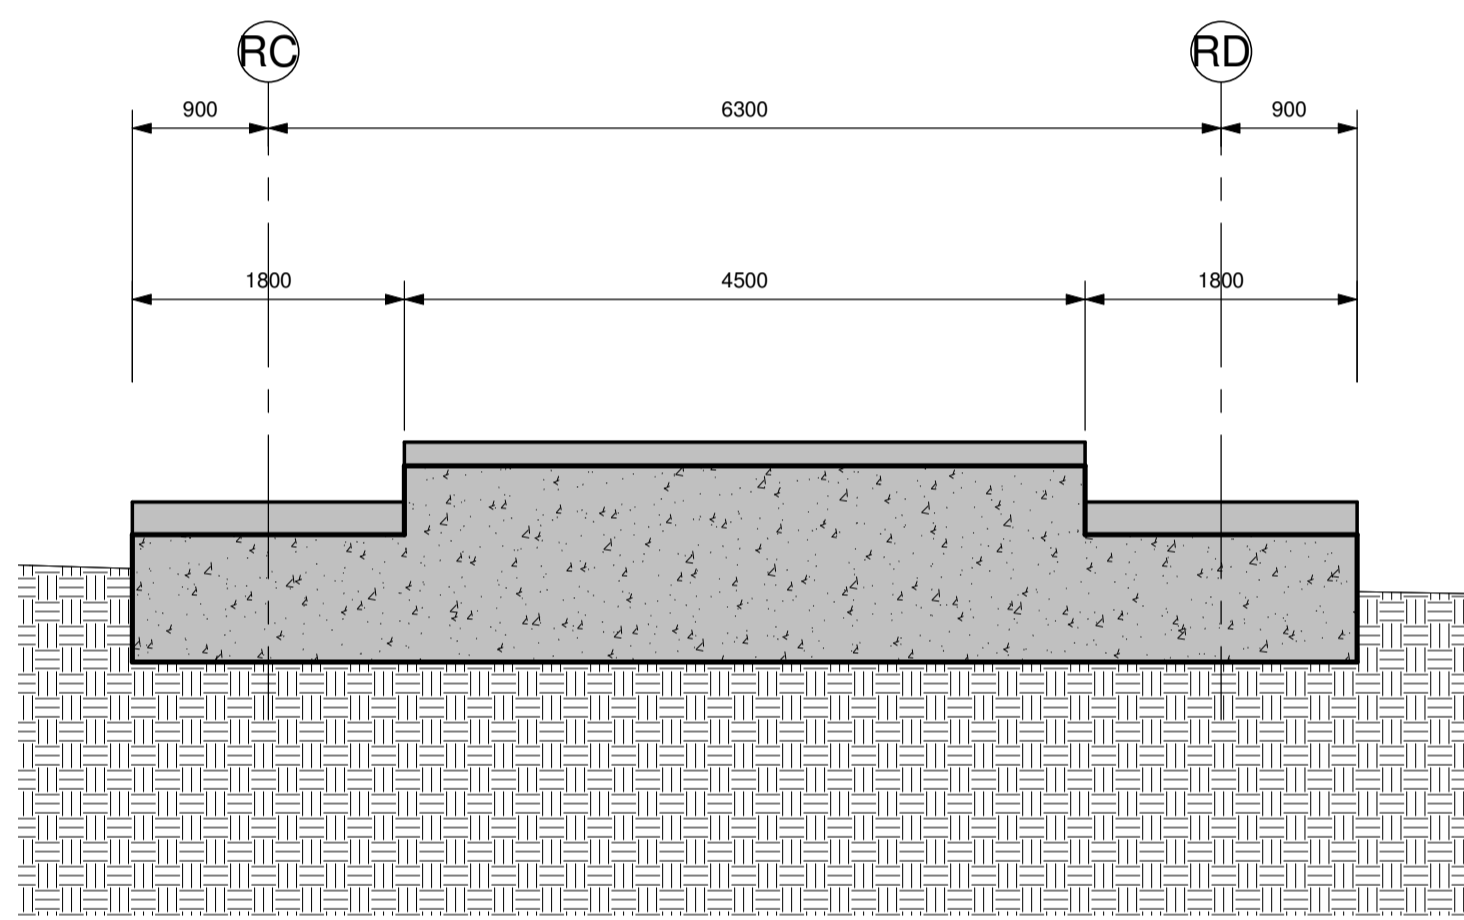


SECTION D - D AT GRID LINE 8
1 : 50

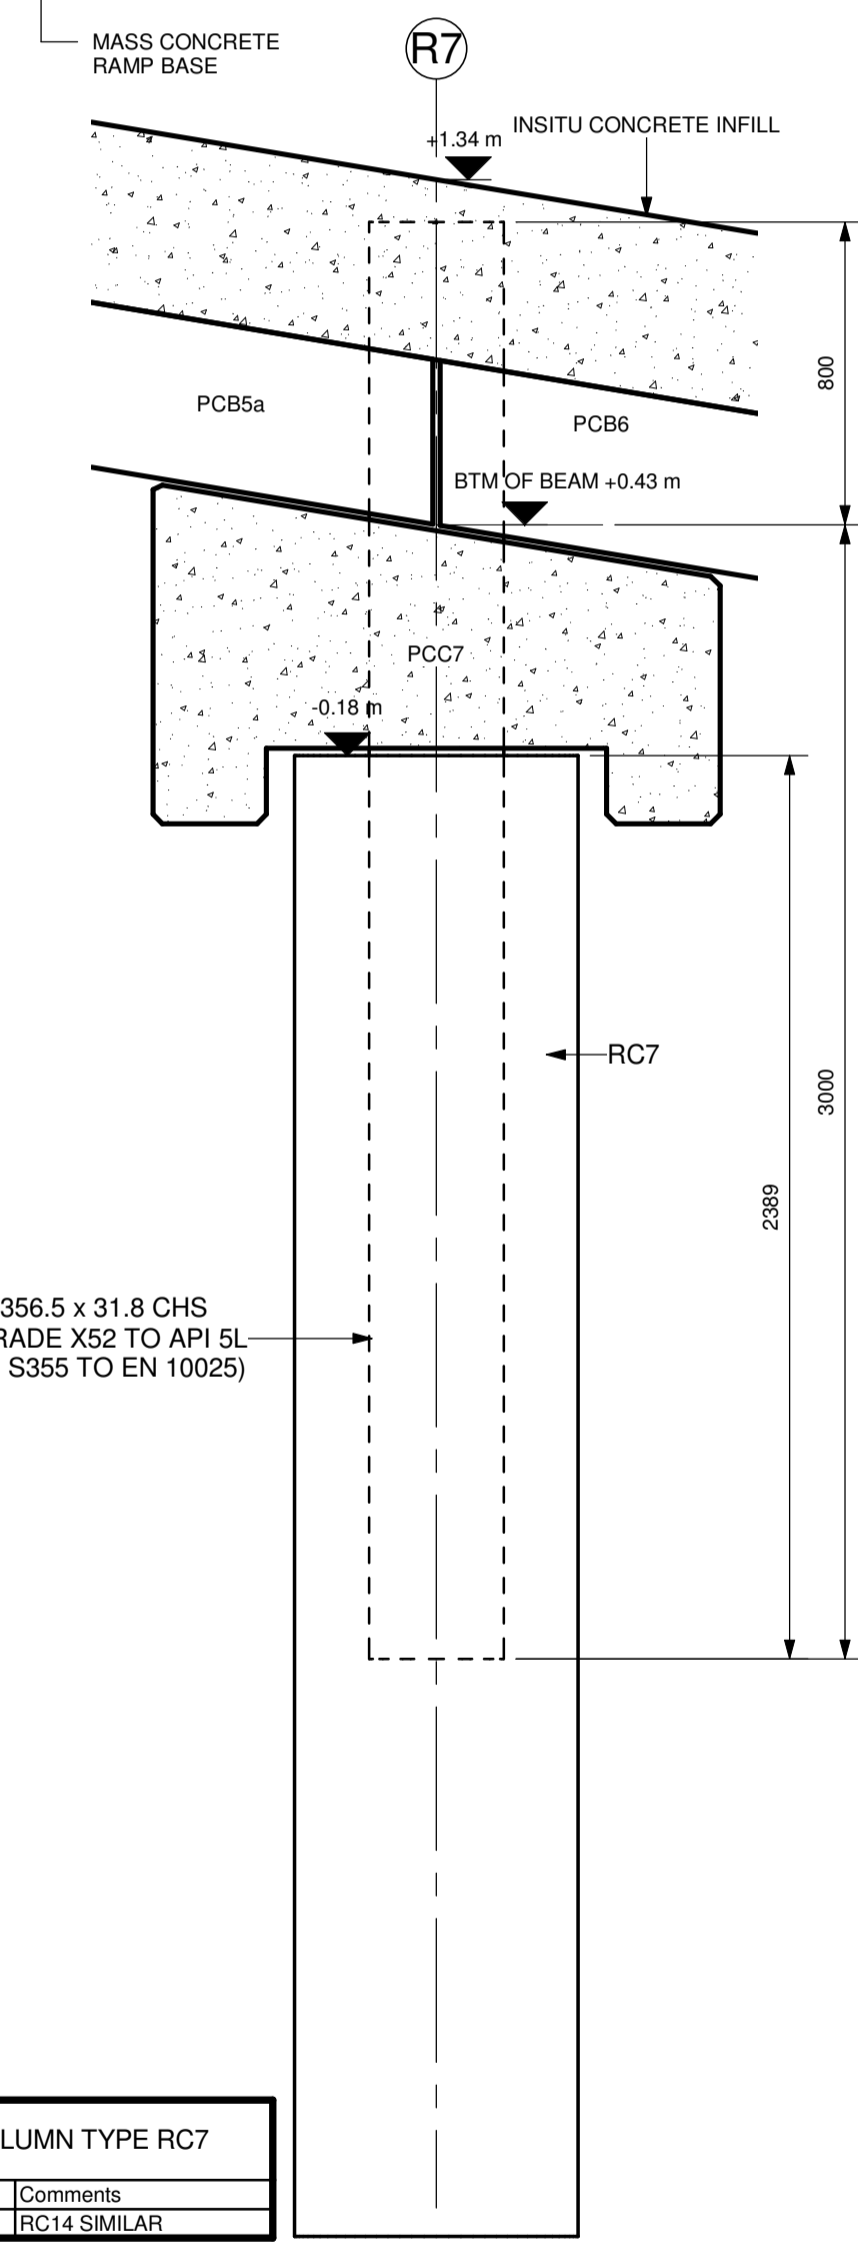


SECTION 2 - 2
1 : 20

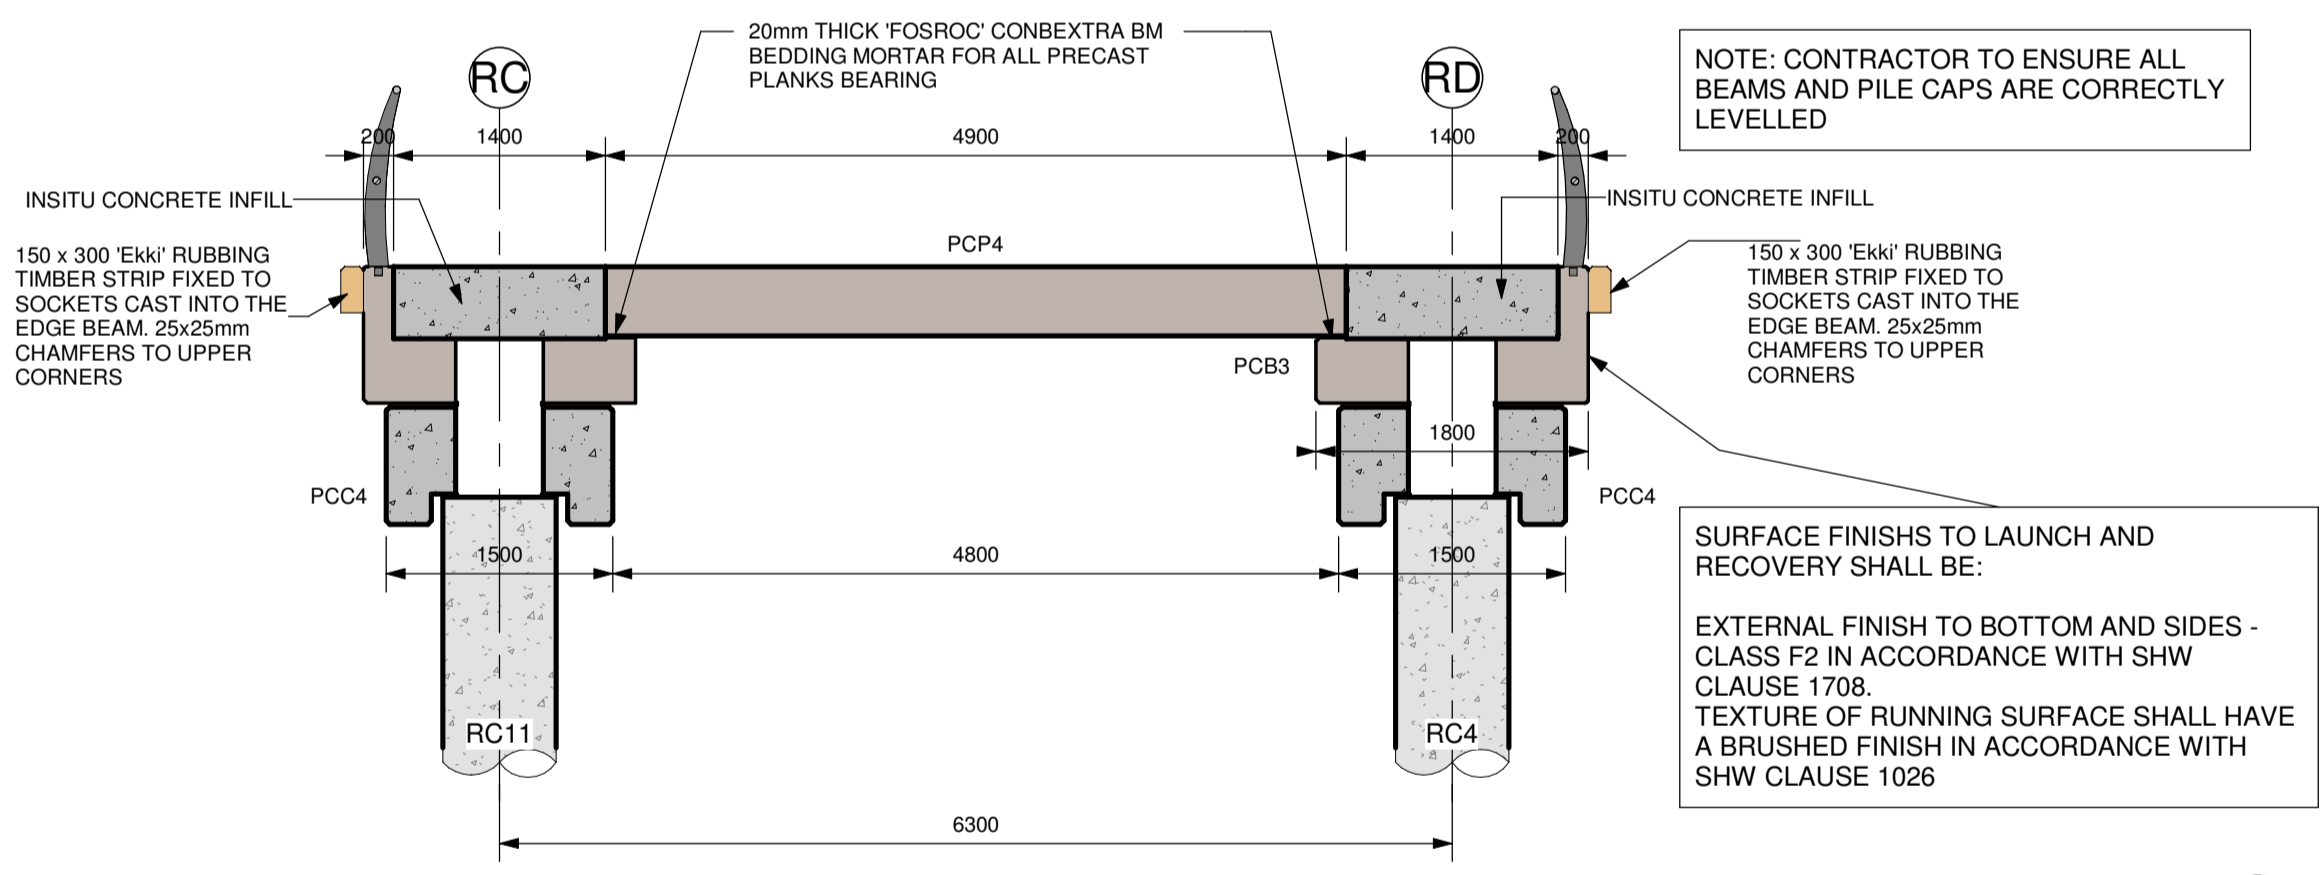

SECTION B - B TYPICAL AT PILE BENTS
1 : 50

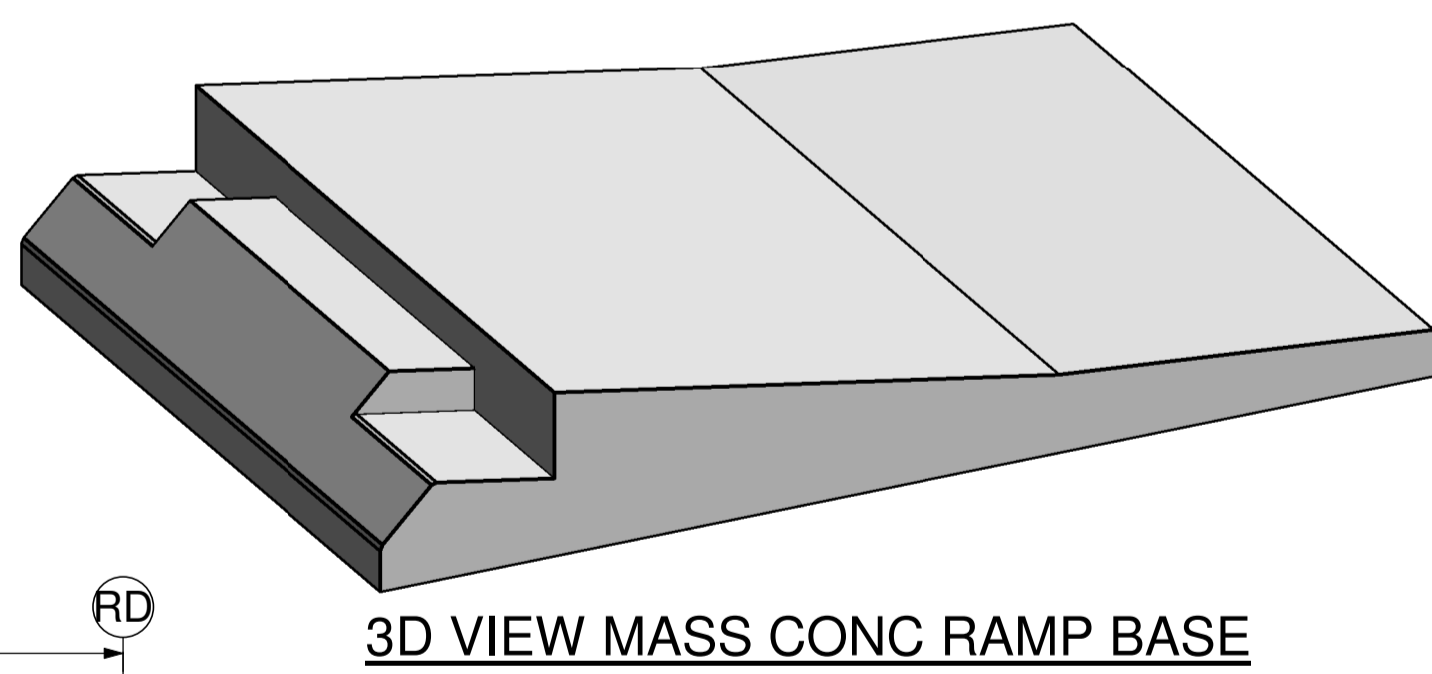


3D VIEW MASS CONC RAMP BASE

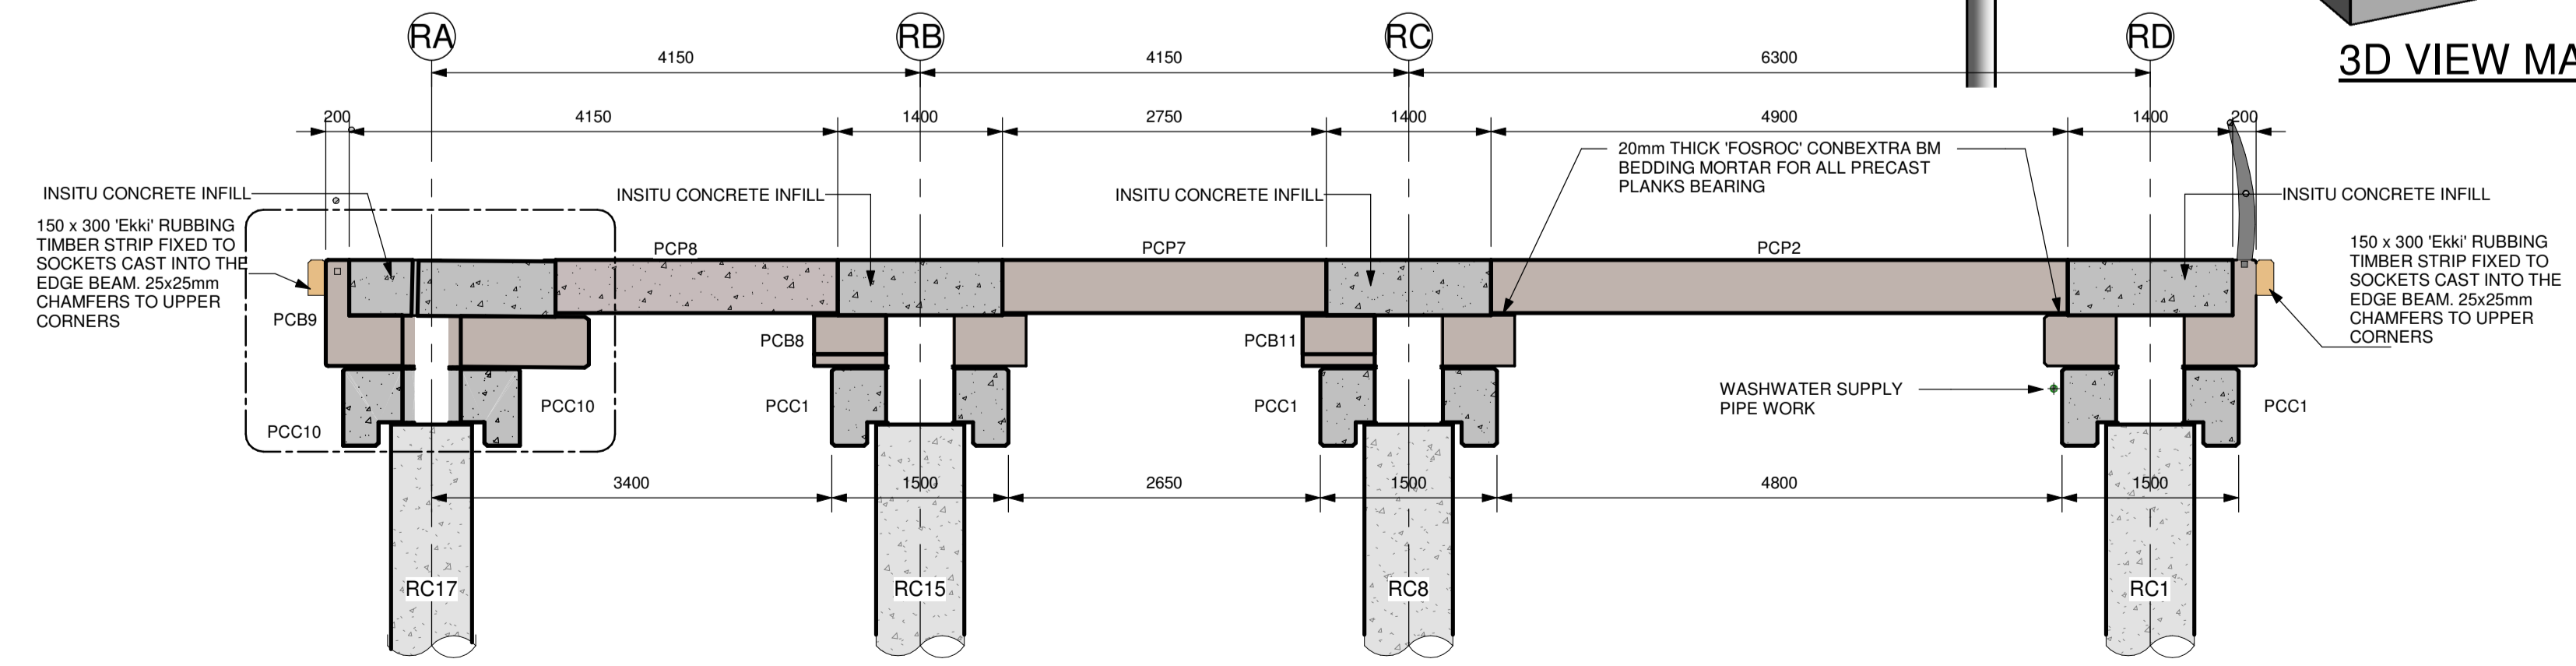

SECTION C - C AT GRID LINE 1
1 : 50

RC COLUMN TYPE RC7		
REF	No.	Comments
RC7	1	RC14 SIMILAR

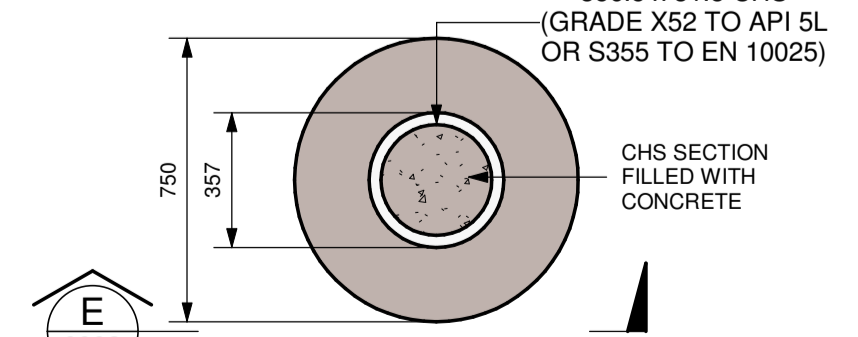

RAMP COLUMN RC7 PLAN
1 : 20

D2 FOR TENDER

REV	DATE	DESCRIPTION	BY	CHK	APP
P01	28.07.23	FOR TENDER ISSUE		MT	MY


REVISIONS

CLIENT



RNLI LIFEBOAT STATION ANSTRUTHER FIFE

GA RAMP SECTIONS

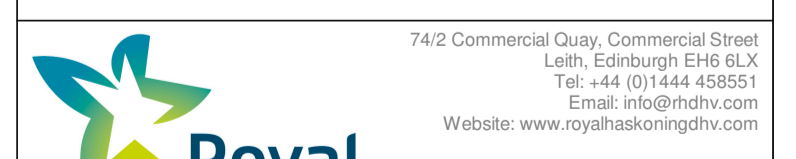

DRAWN	AS	CHECKED	TH	APPROVED	AR
DATE	05/18/21	SCALE	AT A1	As indicated	SCHEDULE REF. N/A
DRAWING No.	PB9049-RHD-ZZ-RP-DR-CM-0002	SUITABILITY	S5	REVISION	P01